


Operating Instructions

Fronius Reserva Pro

12.0 kWh / 16.0 kWh / 20.0 kWh

24.0 kWh / 28.0 kWh / 32.0 kWh

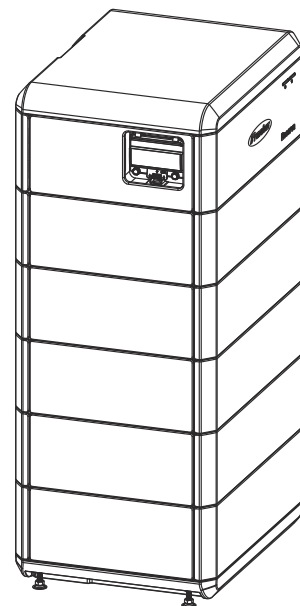

EN | Operating Instructions



42,0426,0606,EA

004-17072026

Table of contents

General information	7
Safety information.....	9
Explanation of warnings and safety instructions.....	9
Safety instructions and important information.....	9
Battery hazard.....	10
Recommended measures in case of emergencies and hazards.....	11
EMC measures.....	12
Electromagnetic fields.....	12
Protective earthing (PE), functional grounding	12
General.....	14
Information on the device.....	14
How information is presented in the document.....	16
Target group.....	16
Data security	16
Privacy policy	17
Copyright.....	18
Fronius Reserva Pro.....	19
Device concept.....	19
Function overview.....	19
Scope of supply	20
Storage.....	21
Intended use.....	21
Foreseeable misuse.....	22
Fronius Solar.web	22
Different operating modes	23
Operating modes – Explanation of symbols.....	23
Operating mode – Solar energy	23
Operating mode – Self-consumption optimization.....	24
Operating mode – Backup power.....	24
Operating mode – Cost-optimized battery charging from the public grid	24
Energy flow direction of the inverter.....	25
Operating states (for battery systems only).....	25
Operating controls and connections.....	27
Connection area	27
Operating controls.....	28
LED status indicator	28
Installation	31
General.....	33
System component compatibility	33
Choosing the Location.....	34
Selecting the battery location.....	34
Battery location requirements.....	35
Installation.....	36
Battery design.....	36
Requirements for connection	38
Various cable types.....	38
Permitted cables for the electrical connection.....	38
Permitted cables for the data communication connection.....	38
Electrical connection.....	39
Safety	39
Switching off the power to the photovoltaic system.....	39
Connecting the ground conductor (PE).....	40
Connecting DC cables	40
Connecting DC cables for battery parallel operation	42
Connecting the data communication cables.....	45
Data communication PIN assignment.....	45

Optical-acoustic signal PIN assignment	45
Connecting the data communication cable to the inverter	46
Connecting a data communication cable for battery parallel operation.....	47
Terminating resistors for systems with a battery	49
Terminating resistors for a system with batteries in parallel operation.....	50
Final tasks.....	53
Selecting the mounting material.....	53
Fitting the mounting bracket	53
Securing the cables in the connection area	54
Fitting the cover to the Reserva Pro BMS	54
Replacing/adding the Reserva Pro module to the battery system.....	55
Safety	55
Requirements for expanding the battery system	55
Setting the State of Charge (SoC) with Service Mode.....	55
Switching off the power to the photovoltaic system and battery.....	56
Removing the covers on the battery	57
Disconnecting and removing the Reserva Pro BMS.....	57
Installing a new Reserva Pro module.....	60
Fitting the Reserva Pro BMS.....	60
Fitting the side covers on the battery	61
Connecting the Reserva Pro BMS.....	61
Securing the cables in the connection area	62
Fitting the mounting bracket	62
Fitting the cover to the Reserva Pro BMS	63
Commissioning	65
Switching on the photovoltaic system	67
Switching on the photovoltaic system.....	67
Manual system start.....	68
Requirements.....	68
Notification of system shutdown.....	68
Manual battery start (dark start) after a system shutdown.....	68
Starting backup power mode after a system shutdown.....	68
Settings – User interface of the inverter	69
General.....	69
Commissioning with the app	69
Commissioning with the browser.....	69
Adding a battery in the user interface of the inverter.....	70
Firmware update	70
Switching the battery off and on.....	72
Switching off the battery	72
Switching on the battery.....	72
Appendix	73
Service, maintenance and disposal.....	75
Cleaning.....	75
Maintenance.....	75
Forced re-charging	75
Disposal	75
Warranty provisions	77
Warranty.....	77
Technical data.....	78
Fronius Reserva Pro 12.0.....	78
Fronius Reserva Pro 16.0.....	79
Fronius Reserva Pro 20.0.....	80
Fronius Reserva Pro 24.0	82
Fronius Reserva Pro 28.0.....	83
Fronius Reserva Pro 32.0.....	84
Explanation of footnotes.....	86
Dimensions	87

Fronius Reserva Pro.....	88
--------------------------	----

General information

Safety information

Explanation of warnings and safety instructions

Warnings are intended to warn people of possible injuries and to avoid personal injury and damage to the product. They relate to individual actions with and on the product.



DANGER!

Indicates an immediately dangerous situation.

Serious injury or death will result if the danger is not avoided.

- Action step to escape the situation.



WARNING!

Indicates a potentially dangerous situation.

Serious injury or death may result if the danger is not avoided.

- Action step to escape the situation.



CAUTION!

Indicates a potentially dangerous situation.

Minor or moderate injury may result if the danger is not avoided.

- Action step to escape the situation.

NOTE!

Indicates a situation that may result in property damage.

If the situation is not avoided, impaired work results, material damage to the product or other property are the possible consequences.

- Action step to avoid the situation.

Safety instructions are designed to ensure safe product use. They are preventive and help to inform users about the fundamental risks involved when dealing with the product. They do not refer specifically to individual actions with and on the product.

Safety instructions and important information

The device has been manufactured in line with the state of the art and according to recognized safety standards.



WARNING!

Incorrect operation or misuse

Serious to fatal injuries to the operator or third parties as well as damage to the device and other property of the operator may result.

- All persons involved in the commissioning, maintenance, and servicing of the device must be appropriately qualified and have knowledge of working with electrical installations.
- Read these operating instructions in full and follow them carefully and precisely.
- The operating instructions must always be kept to hand wherever the device is being used.

IMPORTANT!

In addition to the operating instructions, observe the following general and local rules:

- Accident prevention
- Fire protection
- Environmental protection

IMPORTANT!

Labels, warning notices, and safety symbols are located on the device. A description can be found in these operating instructions.

IMPORTANT!

All safety and danger notices on the device:

- Must be kept in a legible state
- Must not be damaged/marked
- Must not be removed
- Must not be covered, have anything stuck on them, or painted over

**WARNING!****Tampered-with and non-functioning protection devices**

Serious to fatal injuries as well as damage to the device and other property of the operator may result.

- ▶ Never bypass or disable protection devices.
- ▶ Any protection devices that are not fully functional must be repaired by an authorized specialist before the device is switched on.

**WARNING!****Loose, damaged, or under-dimensioned cables**

An electric shock can be fatal.

- ▶ Use undamaged, insulated, and adequately dimensioned cables.
- ▶ Fasten the cables according to the specifications in the operating instructions.
- ▶ Loose, damaged, or under-dimensioned cables must be repaired or replaced immediately by an authorized specialist.

NOTE!**Installations or modifications to the device**

The device may be damaged

- ▶ Do not carry out any alterations, installations, or modifications to the device without first obtaining the manufacturer's permission.
- ▶ Damaged components must be replaced.
- ▶ Only use original spare parts.

Battery hazard**Electrolyte leakage**

- Do not expose the battery to strong shocks/vibrations.
- Do not deform or pierce the battery.
- Do not open or damage the battery.
- Creation of an explosive atmosphere.

Fire

- Short circuits at voltage-carrying parts of the battery, e.g., connection terminals.
- Do not expose the battery to direct sunlight.
- Keep the battery away from fire sources as well as flammable, explosive, and chemical materials.
- Do not place the battery into a fire.

Electric shock

- Contact with live parts such as connection terminals.
- Do not touch the battery with wet hands.
- Keep the battery out of reach of children and animals.
- A battery may pose a risk of electric shock and burns due to a high short circuit current.
- Risk of electric shock from batteries that are submerged in water.

Damage

- Do not immerse the battery in water.
- Risk of mechanical deformation due to load from foreign bodies.
- Do not step on or apply a load to the battery.

Recommended measures in case of emergencies and hazards**Electrolyte leakage**

- Initiate rescue measures, alert and instruct emergency services.
- Contact with skin: Wash thoroughly with soap and water.
- Contact with eyes: Rinse eyes under clear running water for 15 minutes.
- Contact with respiratory tract: Leave the contaminated area immediately and ensure a supply of fresh air.
- If swallowed, do not induce vomiting. Vomiting can cause severe burns in the mouth, esophagus, and gastrointestinal tract.
- Immediately seek medical assistance after first aid measures have been taken.
- Only remove/dispose of leaked electrolyte with suitable protective equipment in accordance with the applicable specifications and guidelines.
- Supply the danger area with sufficient fresh air.

Fire

Battery can ignite if heated above 150 °C. The following measures must be taken if this occurs:

- Initiate rescue measures, alert and instruct emergency services.
- If the battery catches fire during operation, switch off the DC disconnect of the battery, unless there is a direct danger.
- Use a fire extinguisher in accordance with the applicable national regulations.

Extreme natural events

In the event of extreme natural events (e.g., flooding, hurricane, forest fire, etc.), take the following measures:

- Switch off the battery's DC disconnect if this does not pose a danger to life or limb.

Electric shock

- Initiate rescue measures, alert and instruct emergency services.
- Disconnect the PV system and battery from the power supply, provided there is no immediate danger.
- Do not touch the battery if it is wet or submerged in water. Leave the danger zone immediately, alert the emergency services if there is water damage to the battery and contact customer service or the distributor for technical assistance.
- Installing the battery and establishing the cable connections must be carried out by qualified specialists.

Damage

- Damaged batteries are dangerous and must be handled with extreme caution. They must not be used and may pose a danger to people and/or property. If the battery is damaged, immediately switch off the battery's DC disconnect, contact the distributor to arrange repair or return.

EMC measures

In certain cases, even though a device complies with the standard limit values for emissions, it may affect the application area for which it was designed (e.g., when there is equipment that is susceptible to interference at the same location or if the site where the device is installed is close to either radio or television receivers). If this is the case, the operator is obliged to take action to rectify the situation.

Electromagnetic fields

During operation, due to the high electrical voltages and currents, local electromagnetic fields (EMF) are generated. These occur in the immediate vicinity of the inverter and the Fronius system components. Electromagnetic fields are also present in the area of the PV modules and their supply lines.

As long as the intended use and a minimum distance of 20 cm are observed, all limit values for human exposure are observed.

If the limit values are complied with, according to current scientific knowledge, no negative health effects from EMF exposure are to be expected. For persons with prostheses¹⁾ or active physical aids²⁾, there is a possible health risk in the vicinity of photovoltaic system components. To avoid possible health risks, consult with the responsible doctor.

¹⁾ e.g., implants or metal parts

²⁾ e.g., pacemaker, insulin pump, hearing aid, etc.

Protective earthing (PE), functional grounding

The connection of a defined point in the device, system, or installation to earth serves either to protect against electric shock in the event of a fault (protective earthing) or to ensure a defined electrical potential for operation (functional grounding).

When installing a battery system, a ground conductor connection is required depending on the safety class (see [Technical data](#)).


When connecting the ground conductor, ensure that it is secured against unintentional disconnection. All of the points listed in the chapter headed [Connecting the ground conductor \(PE\)](#) on page 40 must be observed. When using cable glands, make sure the ground conductor will be the last conductor subjected to mechanical stress in the event of a cable gland failure. The respective national

standards and regulations and requirements for minimum cross-section must be observed when connecting the ground conductor.

General

Information on the device

Technical data, markings, warnings, and safety symbols are applied to the battery. This information must be kept in a legible condition and must not be removed, covered, painted over, or concealed by stickers or labels. The information and symbols warn against incorrect operation, which may result in serious injury and property damage.

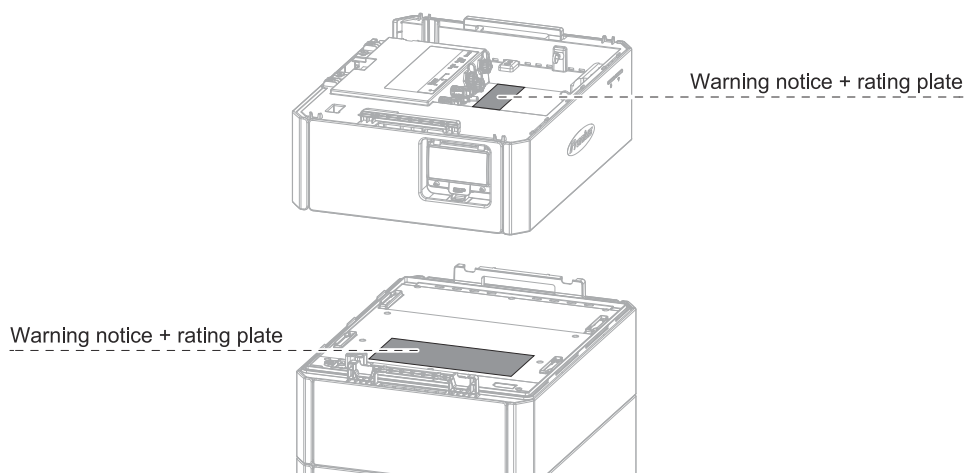

Rating plate / warning notice on the battery management system

Fronius

Lithium Ion Battery System

- ▶ Product name **Reserva Pro**
- ▶ Part number **4,240,391**
- ▶ Max current **50A**
- ▶ IP rating **IP65 (for system)**
- ▶ Operating temperature **-20 ~ 50°C**
- ▶ Protective class **II**
- ▶ Overvoltage category **II**
- ▶ Chemistry **LiFePO₄**
- ▶ Rated capacity **56.6Ah**
- ▶ Weight **10kg ± 5%**
- ▶ Extinguishing Agent **water-based extinguishing agent**

CE

Model	Operating Voltage [V]	Nominal Voltage [V]	Usable Energy [kWh]
☐ Reserva Pro 12.0	165.0 ~ 240.9	212.5	11.96
☐ Reserva Pro 16.0	220.0 ~ 321.2	283.4	15.95
☐ Reserva Pro 20.0	275.0 ~ 401.5	354.2	19.94
☐ Reserva Pro 24.0	330.0 ~ 481.8	425.0	23.93
☐ Reserva Pro 28.0	385.0 ~ 562.1	495.9	27.92
☐ Reserva Pro 32.0	440.0 ~ 642.4	566.7	31.91

Manufacturer Information

Name	Fronius International GmbH
Registered trade mark	
Postal address	Froniusstraße 1, 4643 Pettenbach, Austria
Single contact point	contact@fronius.com
E-Mail address	support@fronius.com
Web address	www.fronius.com

⚠ DANGER / HIGH VOLTAGE INSIDE

- Do not disconnect, disassemble or repair the battery. It may lead to injuries, electric shock or burns. Service by authorized engineers.
- Nicht auseinanderbauen, zerlegen oder reparieren. Es kann zu Verletzungen, Stromschlägen oder Verbrennungen führen. Service nur durch autorisierte Fachkräfte.
- Do not charge or discharge the battery. It may lead to fault, electric shock or burns.
- Nicht laden oder entladen. Dies kann zu Fehlfunktionen, Stromschlägen oder Verbrennungen führen.
- Do not drop, hammer, cut or pierce the battery. It may cause electrolyte leakage or fire.
- Das Gerät nicht werfen, schlagen, schneiden oder mit scharfen Gegenständen beschädigen. Dies kann zu einem Ausströmen von Elektrolyt oder zu Brand führen.
- Bei austretendem Elektrolyt Kontakt mit Augen, Haut oder Kleidung vermeiden. Im Falle eines Kontakts sofort mit Wasser spülen und ärztliche Hilfe aufsuchen.
- Do not place near open flame or incinerate. It may lead to fire or explosion.
- Nicht in der Nähe offener Flammen platzieren oder verbrennen. Es besteht Brand- oder Explosionsgefahr.
- Keep the unit away from moisture or liquid. Do not touch or use if liquids was spilled on it.
- Von Feuchtigkeit oder Flüssigkeiten fernhalten. Gerät nicht berühren oder verwenden, wenn Flüssigkeit darauf verschüttet wurde.
- Keep out of each of children or animals.
- Außer Reichweite von Kindern und Tieren aufbewahren.

Rating plate / warning notice on the battery module

Secondary Li-Ion Battery		Manufacturer Information		WARNING - Do not disconnect, disassemble or repair to avoid injury, electric shock or burns. Service by authorized engineers. - Nicht auseinanderbauen, zerlegen oder eigenständig reparieren, um Verletzungen, Stromschläge oder Verbrennungen zu vermeiden. Service nur durch autorisierte Fachkräfte. - Do not charge or discharge arbitrarily, may lead to malfunction, electric shock or burns. - Nicht eigenmächtig laden oder entladen, dies kann zu Fehlfunktionen, Stromschlägen oder Verbrennungen führen. - Do not damage the unit, do not use as a hammer, impact, cut or spearing with a sharp object. It may cause electrolyte leakage or fire. - Gerät nicht fallen lassen, nicht als Hammer verwenden, stoßen, schneiden oder mit scharfen Gegenständen beschädigen. Dies kann zu einem Austritt von Elektrolyt oder zu Brand führen. - When using, do not have contact with eyes, skin or clothes. In event of accident, flush with water and get medical help immediately. - Bei Ausbe- oder Benutzen Kontakt mit Augen, Haut oder Kleidung vermeiden. Im Falle eines Kontakts sofort mit Wasser spülen und ärztliche Hilfe anfordern. - Do not place the unit in an open flame or incinerate. It may lead to fire or explosion. - Das Gerät nicht in offener Flamme platzieren oder verbrennen. Es besteht Brand- oder Explosionsgefahr. - Keep the unit away from moisture or liquid. Do not touch or use if liquids was spilled on it. - Von Feuchtigkeit oder Flüssigkeiten fernhalten. Gerät nicht berühren oder verwenden, wenn Flüssigkeit darauf verschüttet wurde. - Keep out of each of children or animals. - Außer Reichweite von Kindern und Tieren aufbewahren.
IFP17/102/354 ▶ Product name: Reserva Pro Module ▶ Part number: 4.240.390 ▶ Rated capacity: 56.6 Ah ▶ Usable energy: 3.98 kWh ▶ Nominal voltage: 70.84 V ▶ Voltage range: 55.0 V ~ 80.3 V ▶ Battery category: Industrial Battery ▶ Chemistry: LiFePO₄ ▶ Weight: 36 kg ± 5 % ▶ IP rating: IP20 ▶ Place of manufacture: Kobierzyce, Poland ▶ Extinguishing agent: water-based extinguishing agent	Name: Fronius International GmbH Registered trade mark: Postal address: Froniusstraße 1, 4643 Pettenbach, Austria Single contact point: contact@fronius.com Web address: www.fronius.com E-Mail address: support@fronius.com	 		

Explanation of symbols

	CE label – confirms compliance with applicable EU directives and regulations.
	RCM marking – tested according to the requirements of Australia and New Zealand.
	VDE marking – tested according to the requirements of the Association of Electrical, Electronic and Information Technology (VDE).
	Safety class 2 marking – identifies electrical devices that belong to safety class 2 and have reinforced or double insulation.
	Separate collection – Battery Regulation 2023/1542/EU – batteries must be collected separately in accordance with the EU regulation and handed over to waste management for environmentally sound disposal or recycling.
	Recyclable – the product is recyclable or made from recycled materials.
	Do not reverse polarities
	General Warning Sign
	Warning: Electric voltage
	Warning: Heavy load
	Warning: Hazards due to the charging of batteries
	Warning: Explosive substances
	Follow the operating instructions
	Keep out of reach of children and animals
	No open flame; fire, open source of ignition, and smoking prohibited

Battery code	Description
IFpP	Type of battery (e.g., lithium iron phosphate)
17/102/354	Battery dimensions [mm]

Battery code	Description
[1P22S]	Number of cells in series (22 cells in series)

How information is presented in the document

The conventions regarding how information is presented in the document, which are set out below, have been defined in order to increase the readability and comprehensibility of the document.

Application notes

IMPORTANT! Indicates application notes and other useful information. It does not indicate a harmful or dangerous situation.

Software

Software functions and elements of a graphical user interface (e.g., buttons, menu items) are highlighted in the text with this **mark up**.

Example: Click **Save**.

Instructions for action

1 Action steps are displayed with consecutive numbering.

- ✓ *This symbol indicates the result of the action step or the entire instruction.*

Target group

This document provides detailed information and instructions to ensure that people can use the machine safely and efficiently.

The information is intended for the following groups of people:

- **Technical specialists:** People with appropriate qualifications and fundamental knowledge of electronics and mechanics. The activities of a technical specialist include installation, operation, maintenance, and service work.
- **User:** People that use the machine in daily operation and want to understand its basic functions.

Regardless of any qualifications, only perform the activities listed in this document.

The definition of professional qualifications and their applicability are subject to national law.

Data security

With regard to data security, the user is responsible for:

- Backing up any changes made to the factory settings
- Saving and storing personal settings

NOTE!

Data security for network and Internet connection

Unsecured networks and a lack of safeguards can result in data loss and unauthorized access. Observe the following points for safe operation:

- ▶ Operate inverters and system components on a private, secure network. A WiFi network is considered secure if security standard WPA 2 is satisfied as a minimum.
- ▶ Keep the network devices (e.g., WiFi routers) up to date with the latest technology.
- ▶ Keep the software and/or firmware updated.
- ▶ Use a wired network to ensure a stable data connection.
- ▶ For security reasons, do not make inverters and system components accessible from the Internet via port forwarding or Port Address Translation (PAT).
- ▶ Use the solutions provided by Fronius for monitoring and remote configuration.
- ▶ The optional communication protocol Modbus TCP/IP¹⁾ is an unsecured interface. Only use Modbus TCP/IP if no other secured data communication protocol (MQTT²⁾) is possible (e.g., compatibility with older Smart Meters).

¹⁾ TCP/IP - Transmission Control Protocol/Internet Protocol

²⁾ MQTT - Message Queuing Telemetry Protocol

Privacy policy

When you connect your device (and any associated devices) to the internet, the following device and operating data (device ID/identifier, device IP address, device time, configuration settings, hardware and software information, device status log files, serial number) is sent automatically to

Fronius International GmbH, Froniusstraße 1, 4643 Pettenbach, Austria, telephone +43(0) 7242241-0, email: contact@fronius.com (controller)

and stored.

The processing of this device and operating data is carried out for the purpose of ensuring the operational safety of the device (time synchronization, provision of updates). This processing is therefore necessary for the functionality of the device and thus for the fulfillment of the contract (Art. 6 (1) (b) GDPR).

If you do not wish to have such data processed, you must manually disable the device's internet connection.

In addition, the device and operating data is also processed for the purpose of providing services as part of a supplementary digital service for your device (such as solar.web or similar) as soon as you have registered your device with such a digital service (identification). This data is processed to provide the requested digital services and is therefore necessary for the fulfillment of the contract (Art. 6 (1) (b) GDPR).

Furthermore, this data processing is also carried out for maintenance and support purposes and for handling customer concerns as well as in warranty and guarantee cases (only in individual cases and given connection between device and internet). In this context, the device and operating data may also be passed on to our cooperation partners (third-party providers and suppliers). The processing of this data is necessary for maintenance and support purposes or for processing warranty and guarantee cases and thus for the fulfillment of the contract (Art. 6 (1) (b) GDPR).

Device and operating data are also processed for analysis and diagnostic purposes in order to gain insights into the functionality of the devices and improve them accordingly. This data processing is based on our legitimate interest (Art. 6 (1) (f) GDPR).

We store this data for as long as it is necessary to fulfill the existing contract with you. Any storage beyond this is carried out for legal reasons or if we have a legitimate interest in doing so. For more information on data processing for the solar.web-digital service, as well as our general privacy policy and your rights as a data subject, please visit <https://www.fronius.com>.


Copyright

Fronius International GmbH retains the copyrights of these operating instructions.

Text, illustrations, and other media correspond to the technical state of the art at the time of publication. Fronius reserves the right to make changes. If you have any suggestions for improvement or have found a mistake in this document, we would be most grateful for your comments.

Fronius Reserva Pro

Device concept

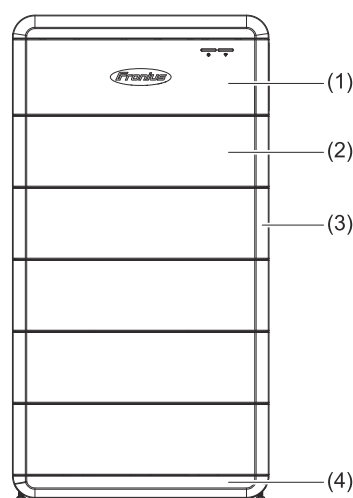

- (1) Battery management system (BMS)
- (2) Battery module
- (3) Cover
- (4) Base plate

The Fronius Reserva Pro battery is a stackable battery system in which a maximum of 4 battery systems can be operated in parallel. Lithium iron phosphate (LFP) batteries are known for their high thermal and chemical stability. The multi-level safety design and intelligent safety monitoring systems ensure safe operation throughout the total life cycle of the batteries.


The Fronius Reserva Pro can be used as a backup power supply when used in combination with a Fronius inverter with backup power capability and backup power changeover with the appropriate configuration.

Function overview

Function	Description
SoC calculation	The current state of charge (SoC) is calculated and displayed in Fronius Solar.web. SoC calibration is carried out every month to ensure the accuracy of the battery system's SoC calculation.
Automatic SoC Balancing	The "Automatic SoC Balancing" function (2% per day) compensates for charge status deviations between Reserva Pro modules that can occur when Reserva modules are replaced/added. This function is disabled in normal operation.
Safety	The battery monitors and protects itself against defective operating behavior: - Overvoltage and undervoltage - Overcurrent - Excessively high or low temperatures - Cell and hardware errors
Dark start	The battery supplies energy for the manual system start (dark start) and the inverter automatically starts backup power mode.
Update	The battery firmware is updated via the inverter's user interface.


Function	Description
Capacity	3 - 8 Reserva Pro modules per battery system and max. 4 battery systems with the same capacity in parallel operation.
Monitoring	Operating data and status indicators are transmitted to the inverter for monitoring via the RS485 interface.

Scope of supply
 Reserva Pro module

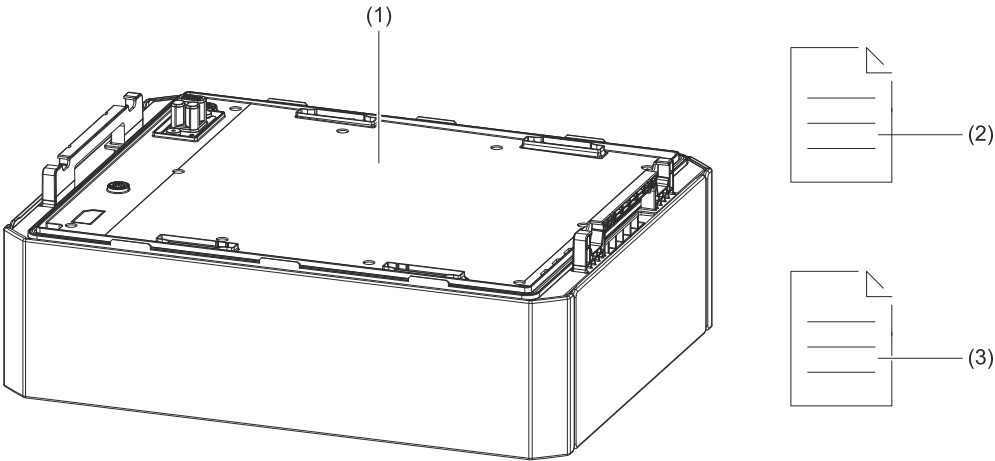

No.	Designation	Quantity
(1)	Battery module	1
(2)	User information	1
(3)	Quick Start Guide	1

Reserva Pro BMS

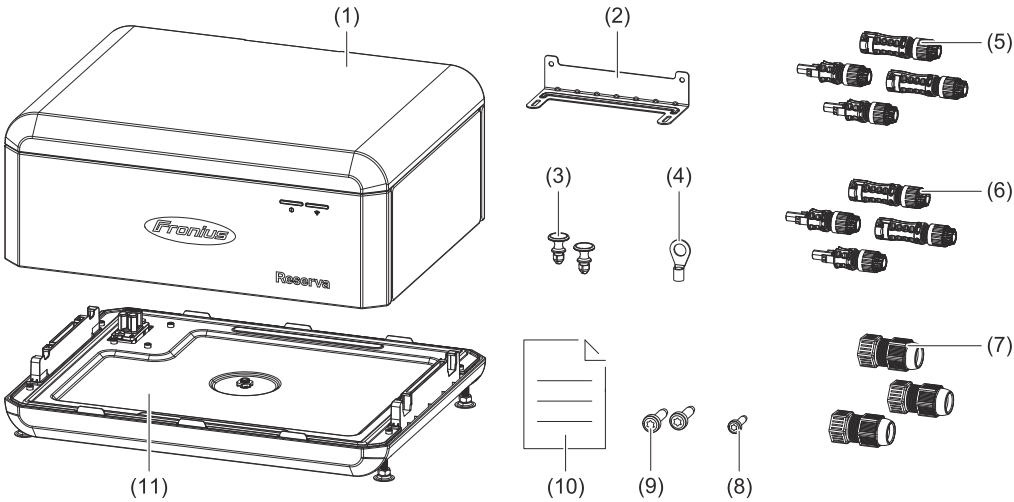

No.	Designation	Quantity
(1)	Battery management system (BMS)	1
(2)	L-shaped mounting bracket	1

No.	Designation	Quantity
(3)	Fastening clip	2
(4)	Cable lug	1
(5)	Stäubli MC4 EVO STO 6 mm ² (+/-)	4
(6)	Stäubli MC4 EVO STO 10 mm ² (+/-)	4
(7)	RJ45 screw connection	3
(8)	M4x10 TX 20 screw	1
(9)	M5x10 TX 20 screw	2
(10)	Quick Start Guide	1
(11)	Base plate	1

Storage

Max. storage period	Temperature range	Relative humidity	SoC*
7 days	-30 °C to -20 °C 45 °C to 60 °C	5% - 95%	15%
12 months	-20 °C to 45 °C	5% - 95%	15%
* State of charge at the time of storage.			

Observe the following storage conditions if batteries have not been used **for more than 7 days**:

- Store according to the instructions on the packaging and do not turn upside down.
- Store protected from direct sunlight and precipitation.
- Maintain a minimum distance of 2 meters from heat sources (e.g., radiators).
- Avoid contact with corrosive and organic substances (including gas).
- Store faulty batteries separately from intact batteries (e.g., structural partition or different fire protection zones).
- The storage area should be dry, clean, and well ventilated.

For batteries that are not used **for more than 12 months**, the following measure is necessary:

- Batteries must be recharged by the manufacturer. The batteries must be sent to the manufacturer for this purpose.

Intended use

The Fronius Reserva Pro battery is designed for storing electrical energy from photovoltaic systems. It is used to store surplus energy and release this again as necessary, in order to optimize the energy supply and maximize the self-consumption of solar energy. The battery is designed for use in private households and for small to medium-sized commercial applications.

The Fronius Reserva Pro can be used as a backup power supply in combination with a Fronius inverter with backup power capability and backup power changeover.

Foreseeable misuse

The following circumstances are considered to be reasonably foreseeable misuse:


- Any use that is not the intended use or goes beyond the intended use.
- The use of incompatible chargers.
- Improper handling, such as dropping or exposing to strong vibrations.
- Backup power mode without suitable changeover devices.
- Modification or manipulation of the battery system that is not expressly recommended by Fronius.
- The supply of loads that require an uninterruptible power supply (e.g., IT networks, life-sustaining medical devices).
- Parallel operation with battery systems of different capacities.

Fronius Solar.web

System owners and installers can easily monitor and analyze the PV system using Fronius Solar.web or Fronius Solar.web Premium. With the appropriate configuration, the inverter transmits system component data such as power, yield, load, and energy balance to Fronius Solar.web. More detailed information can be found at [Solar.web - Monitoring & analysis](#).

Different operating modes

Operating modes - Explanation of symbols



PV module
generates direct current



Fronius hybrid inverter
converts direct current into alternating current and charges the battery (battery charging requires battery support).



Battery
is coupled to the inverter on the direct current side and stores electrical energy.



Primary meter
records the load curve of the system and makes the measured data available for energy profiling in Fronius Solar.web. The primary meter also controls the dynamic power of feeding in.




Loads in the system
are the loads connected in the system.




Grid
supplies the loads in the system if insufficient power is being generated by the PV modules or supplied by the battery.

Operating mode - Solar energy




(1)

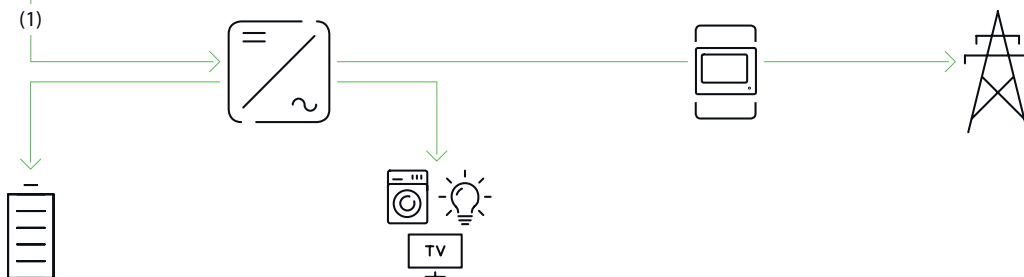

- (1) The solar energy generated supplies the loads in the house, the battery is charged with solar energy and the surplus energy production is fed into the public grid.

Operating mode
- Self-consumption optimization

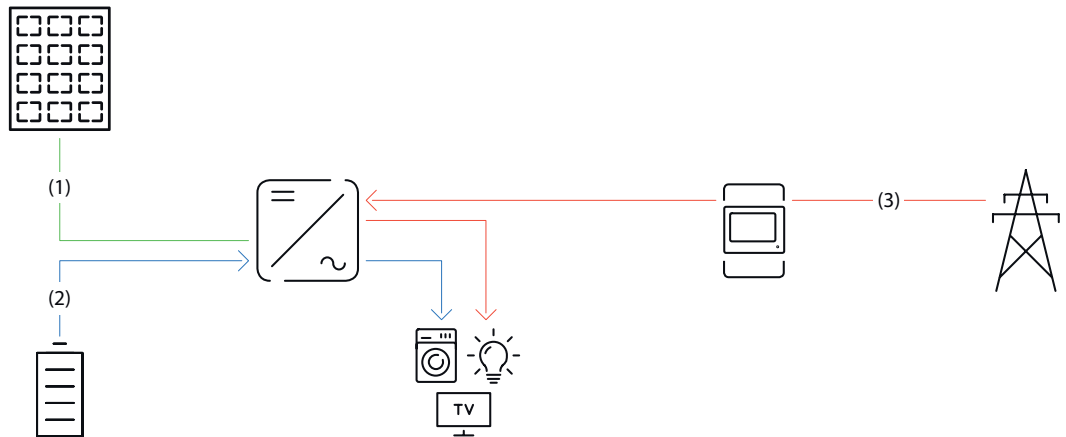


- (1) There is no solar energy available from the PV modules.
- (2) The loads in the house are supplied with energy from the battery.
- (3) The loads in the house are supplied with energy from the public grid if the energy from the battery is insufficient.

Operating mode
- Backup power

IMPORTANT!

Appropriate installation and configuration is a prerequisite for the backup power operating mode.

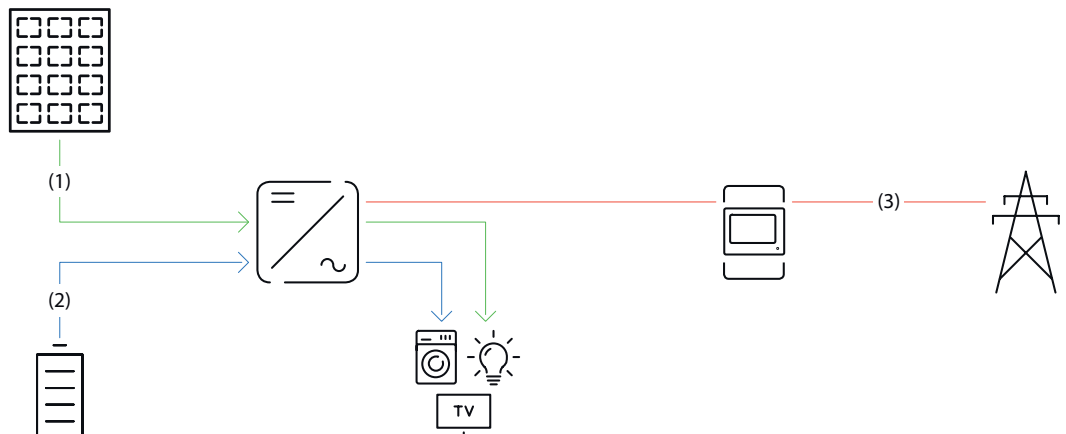


- (1) The loads in the house are supplied with solar energy from the PV modules.
- (2) The loads in the house are supplied with energy from the battery if the solar energy from the PV modules is insufficient.
- (3) There is no energy available from the public grid.

Operating mode
- Cost-optimized battery charging from the public grid


Requirements

- Flexible electricity tariff
- The "Energy Cost Assistant" function in Fronius Solar.web must be activated.
- The restrictions of the grid operator must be taken into account.

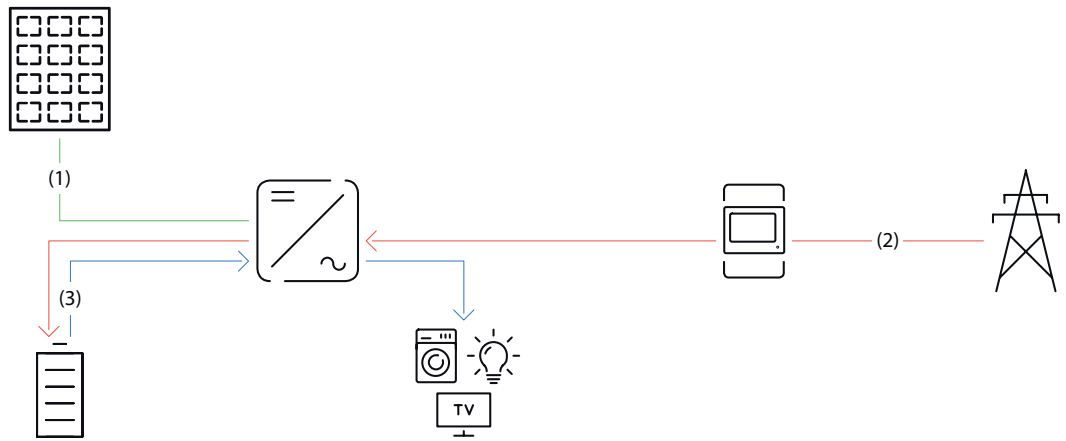

- (1) There is no solar energy available from the PV modules.
- (2) The battery is charged using energy from the public grid at a low electricity price.
- (3) The loads in the house are supplied with energy from the battery.

Energy flow direction of the inverter

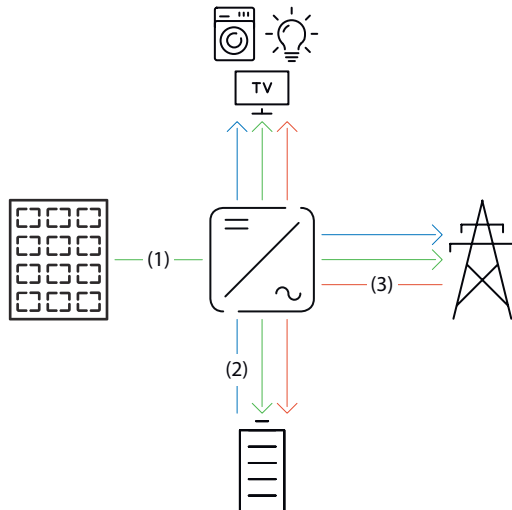

- (1) PV module – inverter – load/ grid/battery
- (2) Battery – inverter – load/grid*
- (3) Grid – inverter – load/battery*

* Charging the battery from the grid depends on the settings, as well as the local standards and directives.

Operating states (for battery systems only)


Battery systems distinguish between different operating states. In each case, the relevant current operating state is displayed on the user interface of the inverter or in Solar.web.

Operating state	Description
Normal operation	Energy is stored or drawn, as required.
Min. state of charge (SoC) reached	The battery has reached the minimum SoC specified by the manufacturer or the set minimum SoC. The battery cannot be further discharged.
Energy saving mode (standby)	The system has been put into energy saving mode. Energy saving mode is automatically ended as soon as sufficient surplus power is available again.

Operating state	Description
Start	The battery system starts from energy saving mode (standby).
Forced re-charging	The inverter re-charges the battery, in order to maintain the minimum SoC specified by the manufacturer or the set minimum SoC (protection against deep discharge).
Calibration charging	The battery system is charged to 100% SoC. After reaching 100% SoC, calibration charging is terminated and the battery switches to normal operation.
Service mode	The battery system is charged or discharged to 15% SoC and 15% SoC is maintained until the end of service mode.
Disabled	The battery is not active. Either it has been disabled or switched off, or communication between the battery and inverter has been interrupted.


Operating controls and connections

Connection area

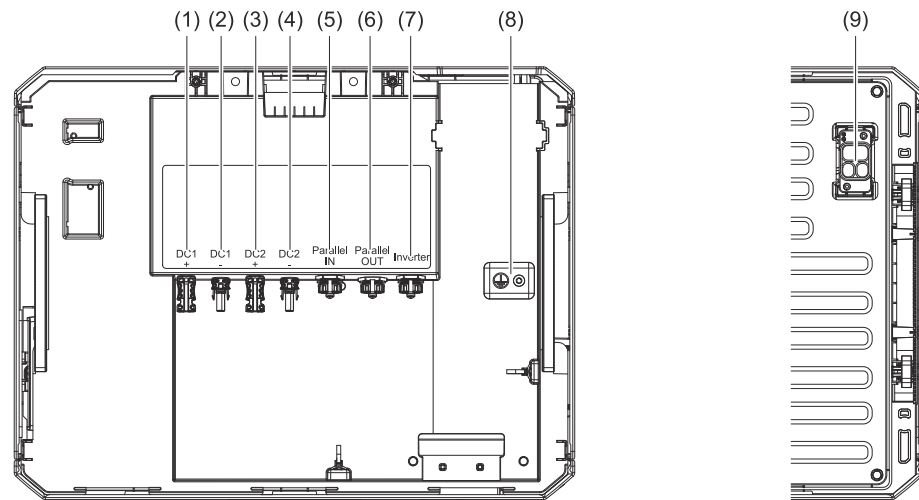



No.	Designation	Description
(1)	DC1+	Positive pole for the DC connection to the inverter
(2)	DC1-	Negative pole for the DC connection to the inverter
(3)	DC2+	Positive pole for the DC connection to the battery in parallel operation
(4)	DC2-	Negative pole for the DC connection to the battery in parallel operation
(5)	Parallel IN	Data communication input between batteries in parallel operation
(6)	Parallel OUT	Data communication output between batteries in parallel operation
(7)	INVERTER	Data communication connection to the inverter
(8)	⏏	PE ground conductor connection
(9)	HVB plug connector	High-voltage battery (HVB) and data communication plug connector

Operating controls

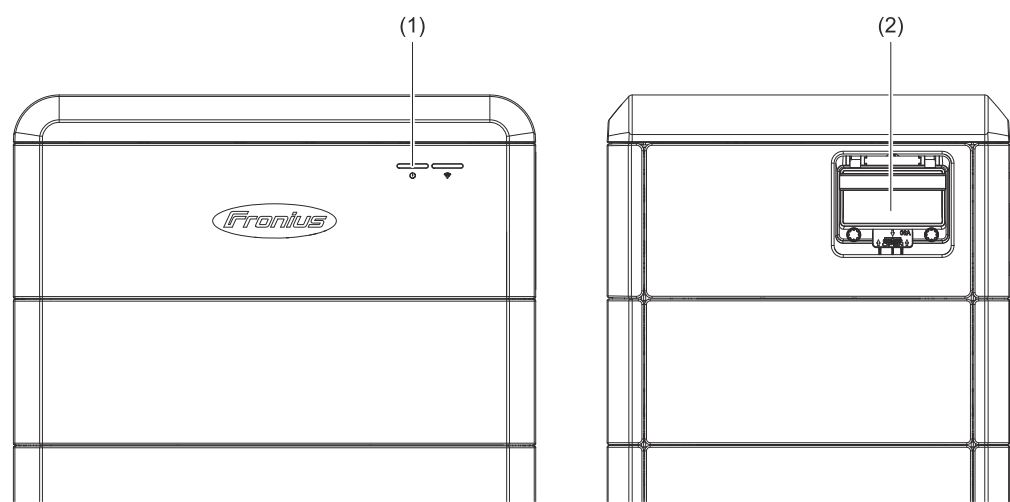

No.	Designation	Description
(1)	LED status indicator	Displays the battery status.
(2)	DC disconnect	Interrupts the current flow between the battery and inverter. A manual battery start (dark start) is performed automatically when the switch is set to "On".

LED status indicator

LED status indicator	
	The battery is starting up or a firmware update is underway.
	Flashes green Flashes blue
	The battery is checking the application mode (parallel or single application mode) or the battery is in standby mode.
	Flashes green
	The application mode check (parallel or single application mode) was performed successfully.
	Lights up green
	The battery displays a non-critical status.
	Flashes red
	The battery displays a critical status.
	Lights up red
	The battery firmware update failed.
	Lights up green Flashes red

LED status indicator



The data connection to the inverter has been established.

- ⏻ Lights up green
- 📶 Flashes blue



The battery is working faultlessly and the data connection to the inverter is active.

- ⏻ Lights up green
- 📶 Lights up blue



The data connection to the inverter is interrupted.

- ⏻ Lights up green
- 📶 Lights up red

Installation

General

System component compatibility

All installed components in the PV system must be compatible with each other and have the necessary configuration options. The installed components must not restrict or negatively affect the functioning of the PV system.

NOTE!

Risk due to components in the PV system that are not and/or only partially compatible.


Incompatible components can restrict and/or negatively affect the operation and/or functioning of the PV system.

- ▶ Only install components recommended by the manufacturer in the PV system.
- ▶ Before installation, check the compatibility of components that have not been expressly recommended with the manufacturer.


Choosing the Location

Selecting the battery location


IMPORTANT! The installation location must be chosen such that all operating controls are easily accessible and simple to operate. The battery must not be covered or installed in enclosures.



Maximum ambient temperature: -20 °C to +50 °C



Relative humidity: 5 to 95%



The battery must not be installed or operated at more than 2000 m above sea level.



The battery is suitable for indoor installation.



The battery is suitable for installation in protected outdoor areas (e.g., under an overhanging roof).



The battery is not suitable for unprotected installation outdoors.

In order to prevent the battery from heating up as much as possible, do not expose the battery to direct sunlight.



The battery is not fully waterproof and must not be immersed in water.



Do not install the battery:

- Where it may be exposed to ammonia, corrosive gases, acids, or salts (e.g., vent openings for livestock stables, chemical plants, tanneries).



Do not install the battery in:

- Areas where there is an increased risk of accidents from farm animals (e.g., horses, cattle, sheep, pigs)
- Stables or adjoining areas
- Storage areas for hay, straw, chaff, animal feed, and fertilizers



Do not install the battery in:

- Greenhouses
- Storage or processing areas for fruit, vegetables, or viticulture products
- Areas used in the preparation of grain, green fodder, or animal feeds




Do not install the battery close to sources of fire or near to flammable, explosive or chemical materials. Ensure a minimum distance of 2 meters from heat sources (max. 60 °C).

Battery location requirements


IMPORTANT!

The battery system must be installed on a sufficiently load-bearing and non-combustible surface (e.g., brick or concrete wall). Installation sites for battery storage systems must be effectively ventilated to the outside if the indoor space does not guarantee sufficient ventilation.

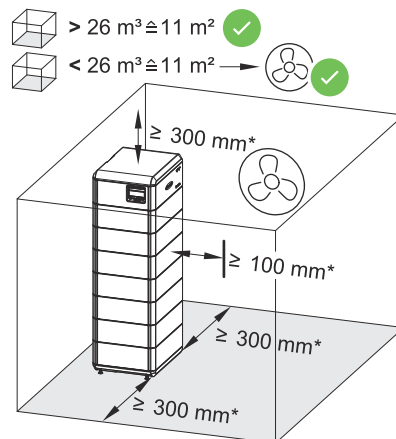

A minimum clearance of 300 mm is recommended on the left and right sides of the battery.

* In Australia, all objects that are not part of the PV system must be at least 600 mm away from the battery.

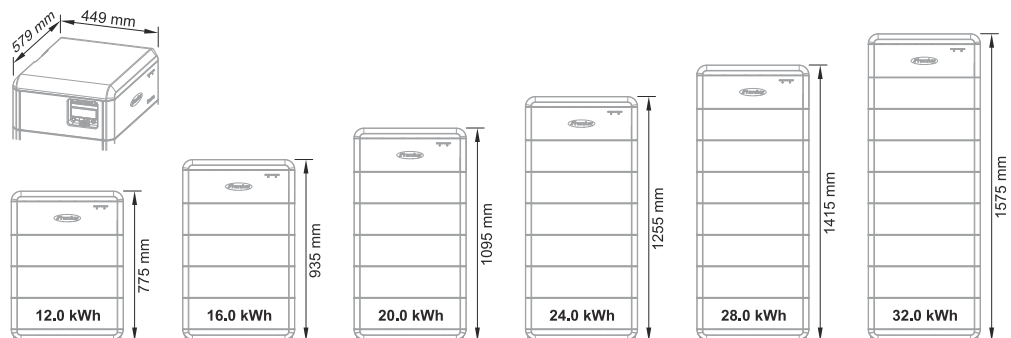

For detailed information regarding the battery dimensions, see chapter [Dimensions](#) on page 87.

Installation

Battery design



Danger of electric shock from live HVB plug connectors.

This can result in severe personal injury and damage to property.

- ▶ Use the integrated carrying handles for lifting the battery and setting it down.
- ▶ Wear personal protective equipment.
- ▶ Remove conductive objects such as watches, bracelets, and rings.



Danger due to soiled battery connections.

This can result in severe personal injury and damage to property.


- ▶ Protect the battery connections from dirt.
- ▶ Check the battery connections for soiling.
- ▶ Always use personal protective equipment (insulated gloves, safety goggles, protective clothing) when cleaning soiled battery connections and remove soiling with a lint-free cloth without the use of cleaning agents.



Danger due to improper battery transportation or installation.


This can result in injuries.

- ▶ Lifting and lowering should be performed by at least 2 people.
- ▶ Use the integrated carrying handles.
- ▶ When lowering the battery, make sure that limbs do not come between the battery and the fixtures.
- ▶ Wear personal protective equipment.

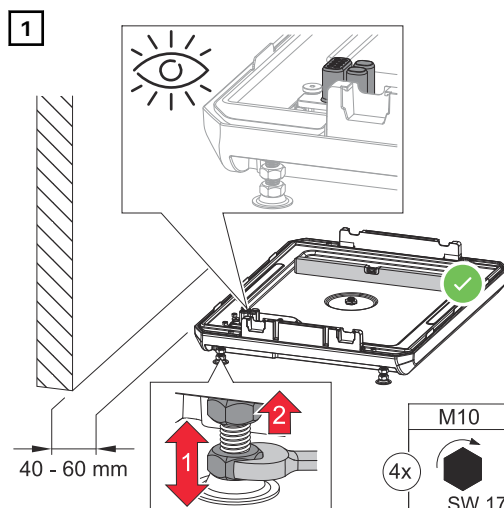


Position the base plate parallel to the wall at a distance of 40 - 60 mm and align it horizontally by turning the adjustable feet with a flat spanner (17 mm).

2

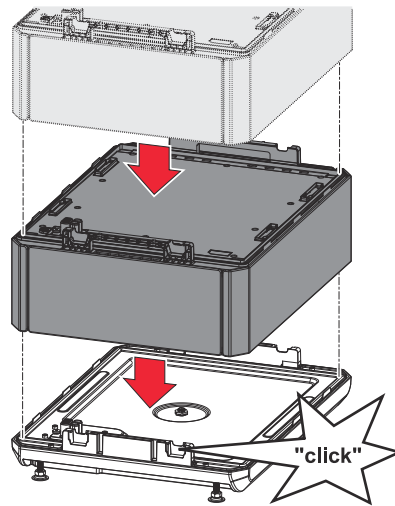

Arrange the Reserva Pro modules in parallel and press into place until the modules engage on both sides with an audible click.




3

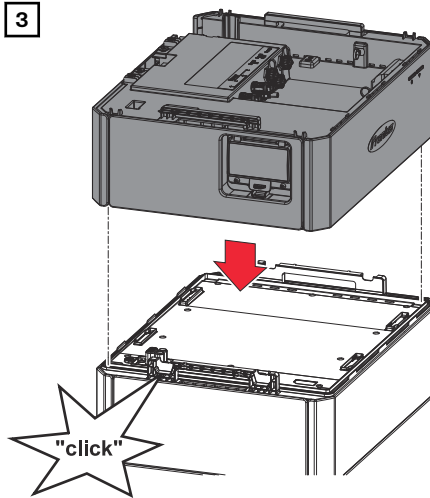

Arrange the Reserva Pro BMS in parallel on the last Reserva Pro module and press into place until the BMS engages on both sides with an audible click.

Requirements for connection



Various cable types




Solid	Multi-stranded	Fine-stranded
		

Permitted cables for the electrical connection

IMPORTANT! The cables used must comply with the requirements of EN 50618 or IEC 62930. Cables that do not comply with EN 50618 or IEC 62930 have a lower current carrying capacity and the technical specialist is responsible for ensuring appropriate cable dimensions and cable lengths.

Round copper conductors can be connected to the terminals as described below:

DC connections				
Manufacturer	Ø insulation layer	Stripping length		
Stäubli MC4 EVO STO 6 mm ²	4.7-6.4 mm	7 mm	6 mm ²	6 mm ²
Stäubli MC4 EVO STO 10 mm ²	6.4-8.5 mm	7 mm	10 mm ²	10 mm ²

PE ground conductor connection (ring cable lug)					
Material	Ø bore	Torque			
Copper with tin coating	4 mm	3 Nm	2.5 - 6 mm ²	2.5 - 6 mm ²	2.5 - 6 mm ²

Permitted cables for the data communication connection

RJ45 connection			
Cable recommendation	Max. cable length		
Min. CAT 5 STP (shielded twisted pair)	30 m	0.14 - 1.5 mm ²	0.14 - 1.5 mm ²

Electrical connection

Safety



WARNING!

Danger due to incorrect operation and incorrectly performed work.

This can result in serious injury and damage to property.

- ▶ Only a technical specialist is permitted to perform commissioning, maintenance, and service activities for inverters and batteries, and only within the scope of the technical regulations.
- ▶ Read the installation instructions and operating instructions from the respective manufacturer before installing and commissioning the equipment.



WARNING!

Danger from mains voltage and DC voltage from the PV module that are exposed to light, as well as batteries.

This can result in serious injury and damage to property.

- ▶ All connection, maintenance, and service work should only be carried out when the AC and DC sides have been disconnected from the inverter and battery, and are de-energized.
- ▶ Only a technical specialist is permitted to connect this equipment to the public grid.



WARNING!

Danger from damaged and/or contaminated terminals.


This can result in serious injury and damage to property.

- ▶ Prior to connection work, check the terminals for damage and contamination.
- ▶ Remove any contamination while the equipment is de-energized.
- ▶ Have defective terminals repaired by a technical specialist.


Switching off the power to the photovoltaic system

IMPORTANT! Allow the capacitors of the inverter to discharge.

1



AC OFF




DC OFF

Turn off the automatic circuit breaker. Set the switch position of the inverter's DC disconnecter to "Off".

Connecting the ground conductor (PE)

IMPORTANT! The battery modules are connected to one another in the battery system via a common ground connection. This ensures equipotential bonding of the battery system. An additional ground connection to the individual battery modules is neither necessary nor permitted.

IMPORTANT! The technical specialist is responsible for selecting the cable lug and screw lock.

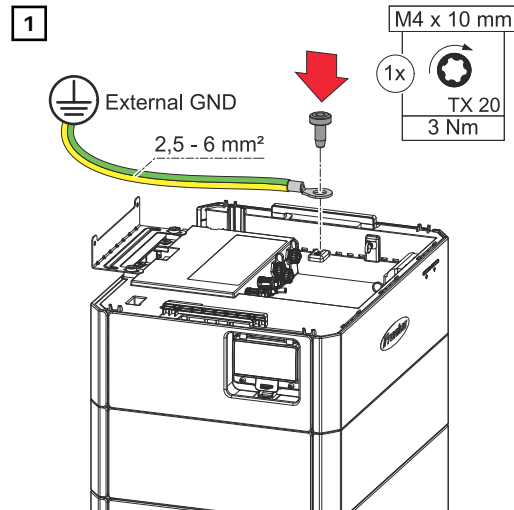

Fasten the ground conductor (PE) to the ground conductor connection using the M4x10 TX20 screw supplied and a torque of 3 Nm.

Connecting DC cables



WARNING!

Danger from loose and/or incorrectly clamped single conductors.


This can result in severe personal injury and damage to property.

- ▶ Check that the single conductors are secure in the crimp contacts.
- ▶ Ensure that the single conductor is fully in the crimp contact and that no individual strands are protruding.

IMPORTANT!


The maximum cable length between the inverter and battery is 40 m.

1

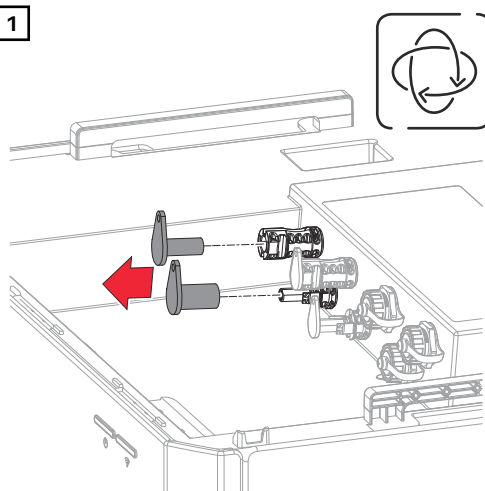

Remove the caps.


2

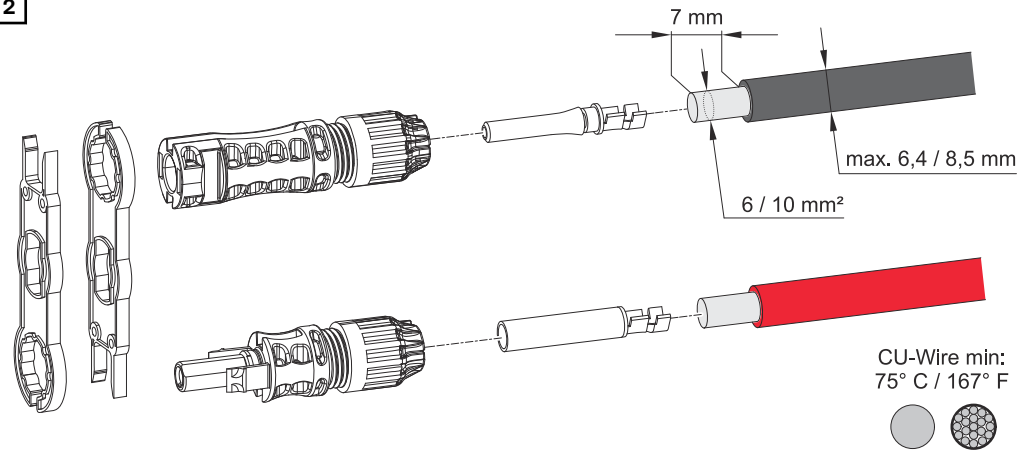

Select the cable cross-section according to the information in [Permitted cables for the electrical connection](#) on page 38. Strip 7 mm (0.27 inches) of insulation from the single conductors.


3

Attach the crimp contact to the individual conductors using a suitable crimping tool.

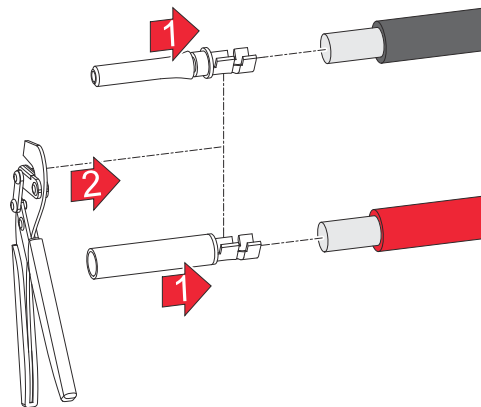


4

Push the crimp contact into the MC4 plug with an audible click.

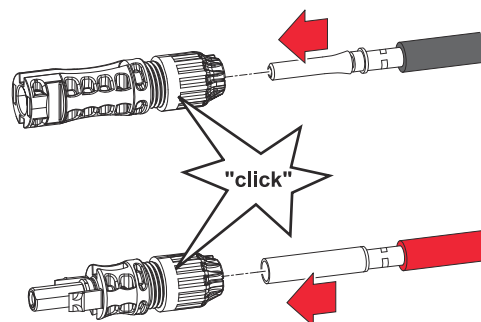

5

2,5 - 3 Nm

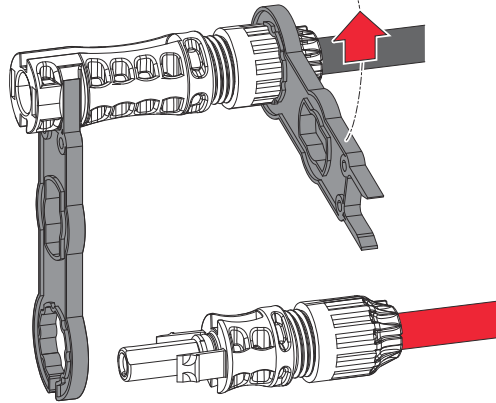


Tighten the cable glands with a torque of 2.5 Nm - 3 Nm.


IMPORTANT!

Full selectivity of the overcurrent protection devices is only guaranteed if they are installed correctly.

6



Push the MC4 plugs (+/-) into the DC1+/DC1- slots until they click into place.

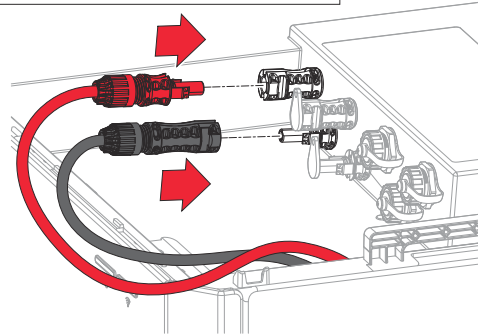

Connecting DC cables for battery parallel operation



WARNING!

Danger from loose and/or incorrectly clamped single conductors.

This can result in severe personal injury and damage to property.

- ▶ Check that the single conductors are secure in the crimp contacts.
- ▶ Ensure that the single conductor is fully in the crimp contact and that no individual strands are protruding.


IMPORTANT!

The maximum cable length between the inverter and the last battery system is 40 m and the maximum cable length between the battery systems is 7 m. The cable lengths between the battery systems should be as short as possible and identical cable lengths should be used in order to avoid current differences between the battery systems.


1



Remove the caps.

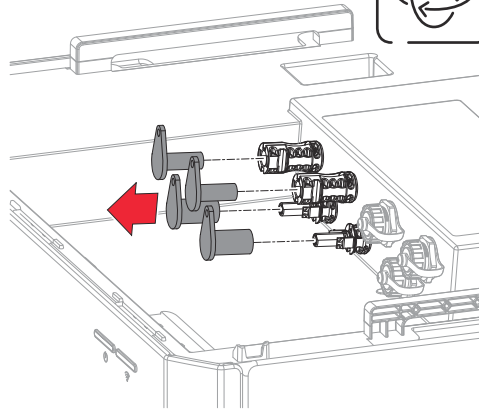


2

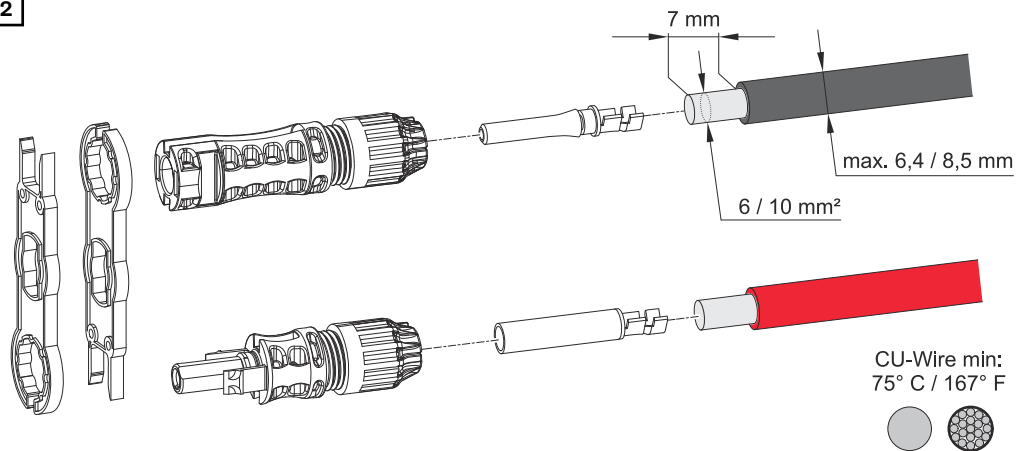

Select the cable cross-section according to the information in [Permitted cables for the electrical connection](#) on page 38. Strip 7 mm (0.27 inches) of insulation from the single conductors.


3

Attach the crimp contact to the individual conductors using a suitable crimping tool.

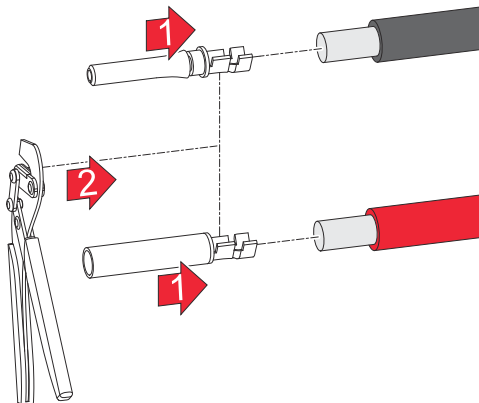

4


Push the crimp contact into the MC4 plug with an audible click.

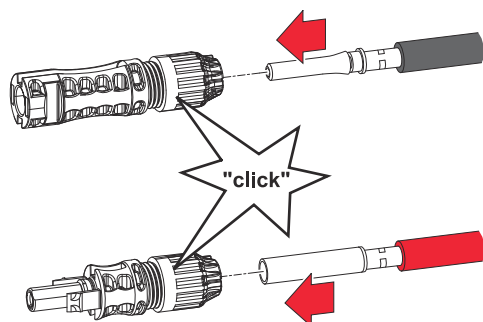

5

2,5 - 3 Nm


Tighten the cable glands with a torque of 2.5 Nm - 3 Nm.

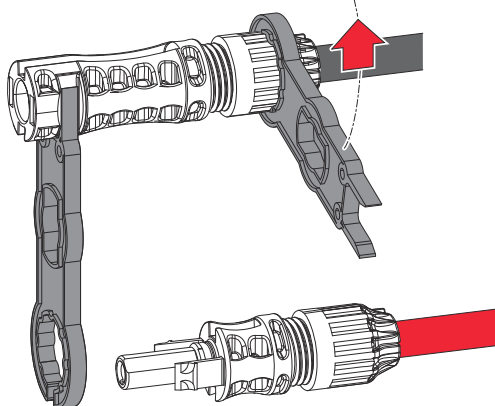

IMPORTANT!

Full selectivity of the overcurrent protection devices is only guaranteed if they are installed correctly.

6

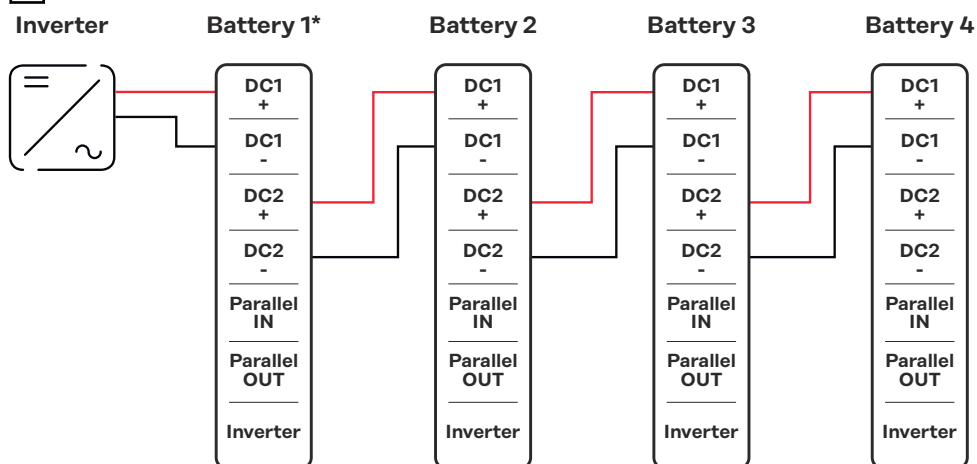

* Use only DC1+/- to connect battery 1 to inverter.


Push the MC4 plug (+/-) into the respective slot until it clicks into place.

Connecting the data communication cables

Data communication PIN assignment

Observe the following points when connecting the data communication cable.


- Use network cables of type CAT5 STP or higher.
- Use twisted pairs of cables for data cables that belong together.
- Use double-insulated or sheathed data cables if they are in the vicinity of bare conductors.
- Use shielded twisted pairs of cables to avoid interference.

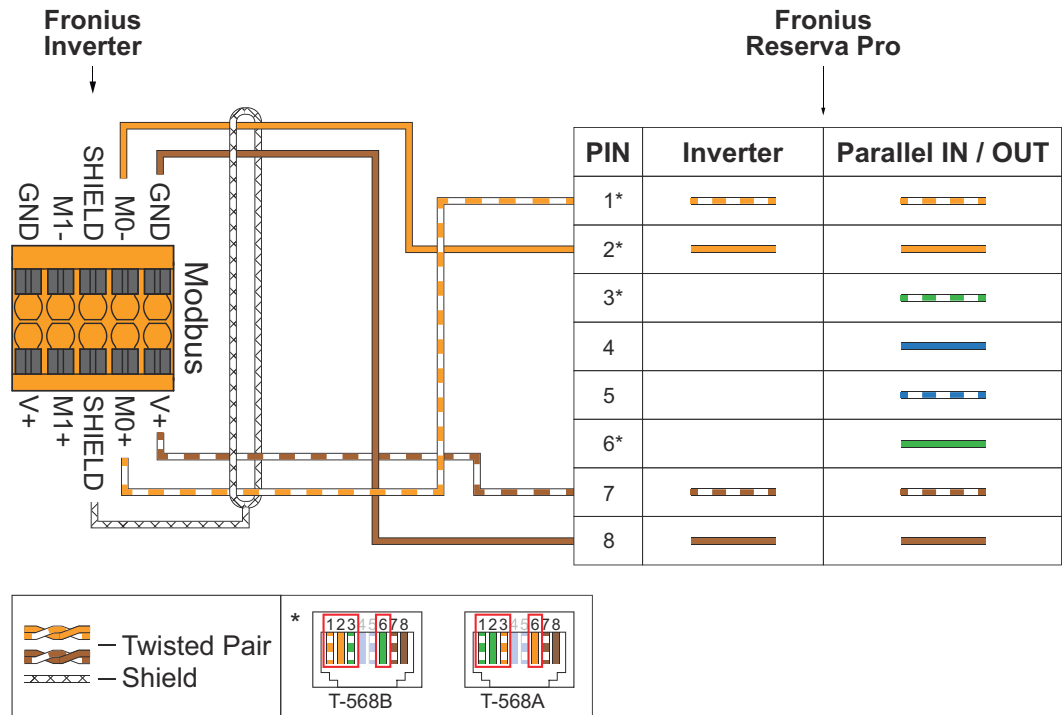

Optical-acoustic signal PIN assignment

Observe the following points when connecting an optical-acoustic signal.


- A suitable relay must be used to ensure an adequate power supply for the optical-acoustic signal used.
- An unassigned "Parallel OUT" data communication output is required for the connection.
- Use network cables of type CAT5 STP or higher.
- Use double-insulated or sheathed data cables if they are in the vicinity of bare conductors.
- Use shielded twisted pairs of cables to avoid interference.

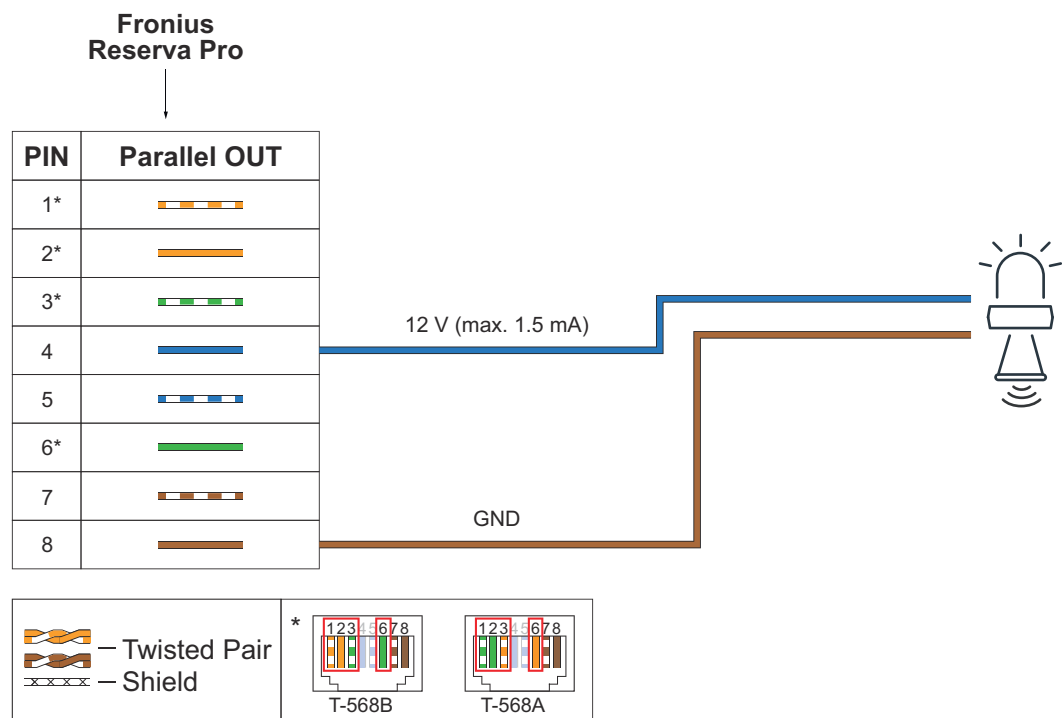


Connecting the data communication cable to the inverter

IMPORTANT!

It is not possible to guarantee effectiveness of the cable gland and IP65 protection class for the data communication connection if the connection is not established correctly.

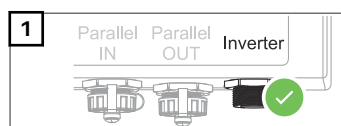


Unscrew the cap on the "Inverter" data communication connection.

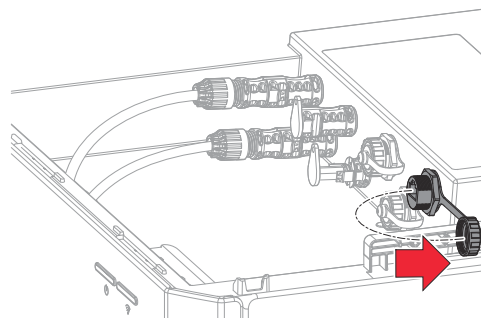


2

First feed the data cable through the union nut and then through the seal and cable gland.



3

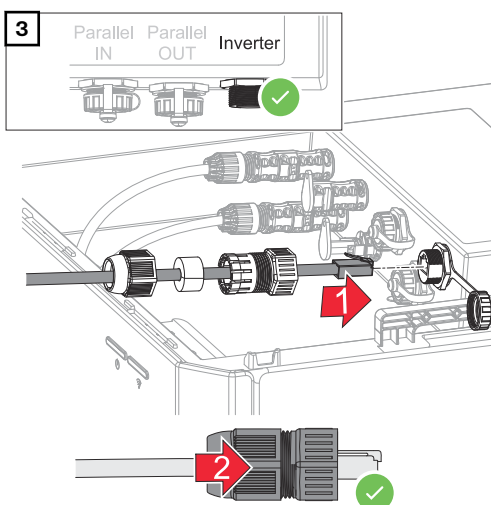

Connect the data cable to the "Inverter" data communication connection with an audible click. Fasten the union nut to the cable gland.

Connecting a data communication cable for battery parallel operation

IMPORTANT!



The maximum cable length between the inverter and the battery is 30 m and the maximum cable length between the battery systems is 10 m.

IMPORTANT!

It is not possible to guarantee effectiveness of the cable gland and IP65 protection class for the data communication connection if the connection is not established correctly.

Overview


The terminating resistors are integrated in the Reserva Pro BMS. As such, no configuration or installation of terminating resistors on the battery is required.

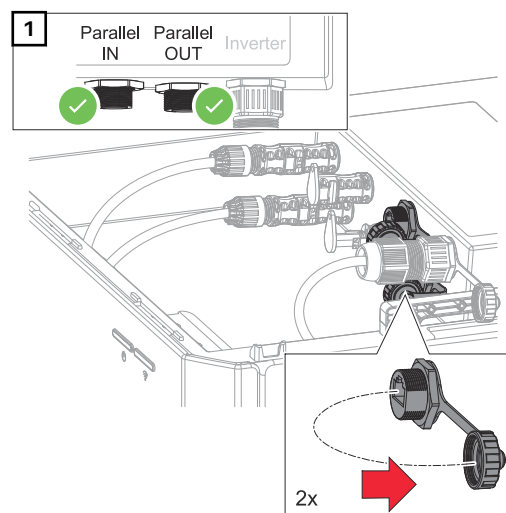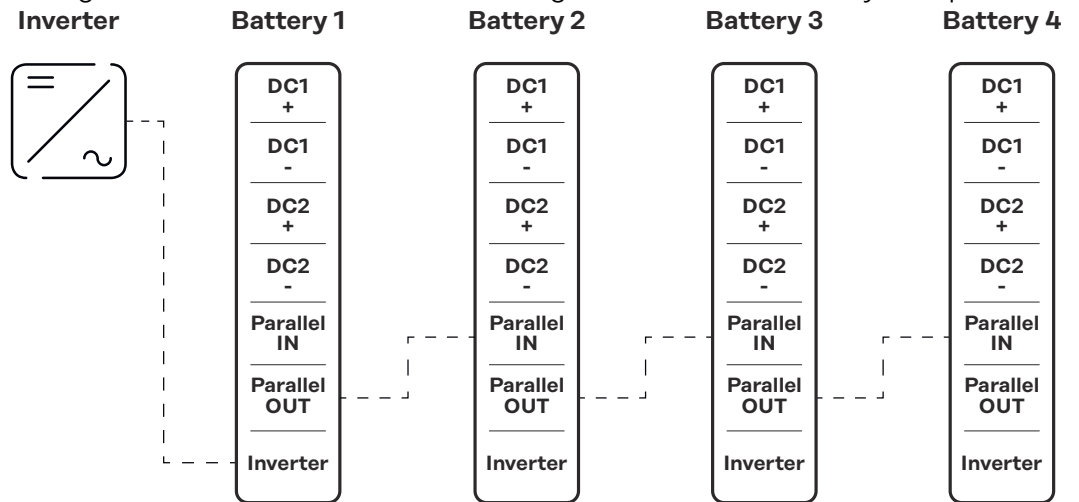


Unscrew the caps on the "Parallel IN" and "Parallel OUT" data communication connections.

2

First feed the data cable through the union nut and then through the seal and cable gland.

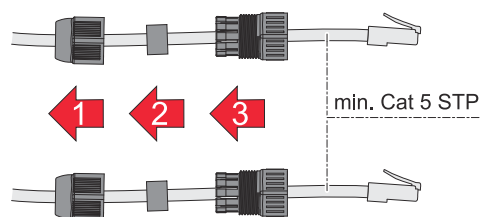

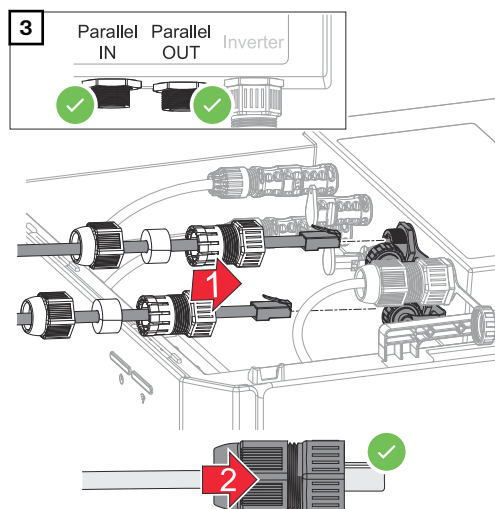


Connect the data cables to the "Parallel IN" and "Parallel OUT" data communication connections with an audible click. Fasten the union nuts to the cable glands.

Terminating resistors for systems with a battery


Installation without terminating resistors can lead to interference during operation of the photovoltaic system. To ensure faultless functionality, install terminating resistors according to the following overview.

For permitted cables and maximum distances for the data communication area, see chapter [Permitted cables for the data communication connection](#) on page 38.

OPTION 1

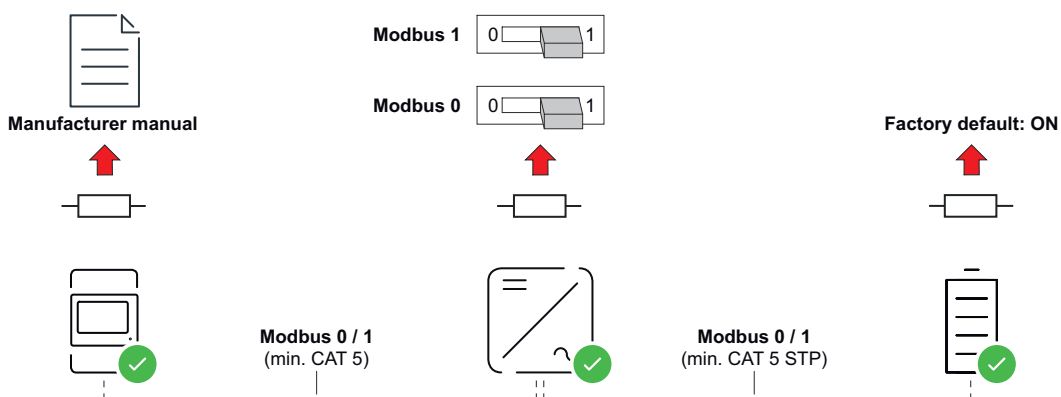



OPTION 2

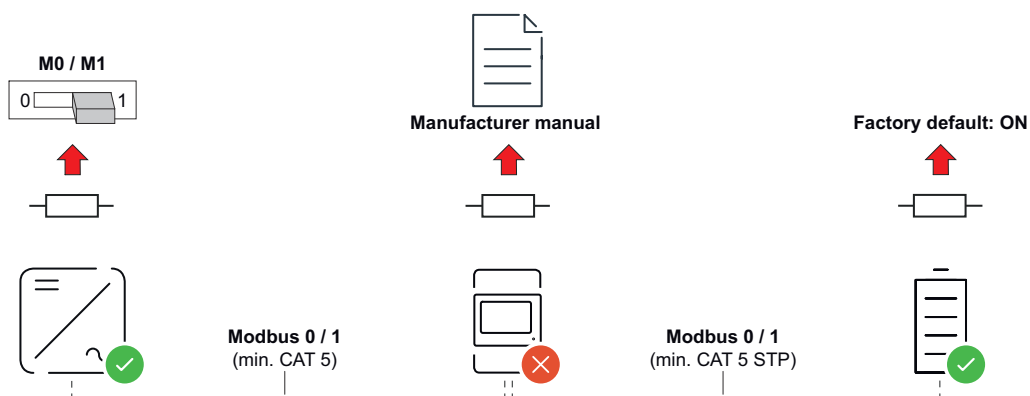


Terminating resistors for a system with batteries in parallel operation

Installation without terminating resistors can lead to interference during operation of the photovoltaic system. To ensure faultless functionality, install terminating resistors according to the following overview.


For permitted cables and maximum distances for the data communication area, see chapter [Permitted cables for the data communication connection](#) on page 38.

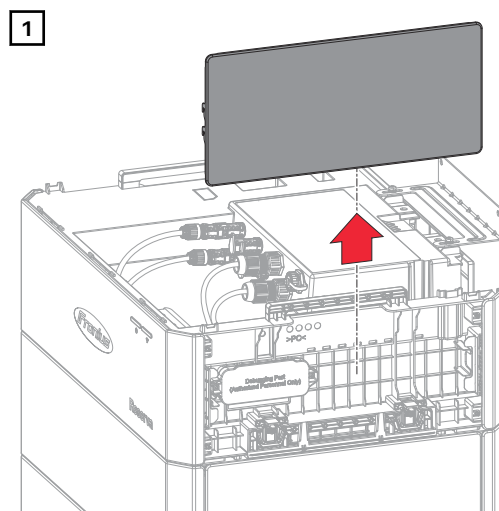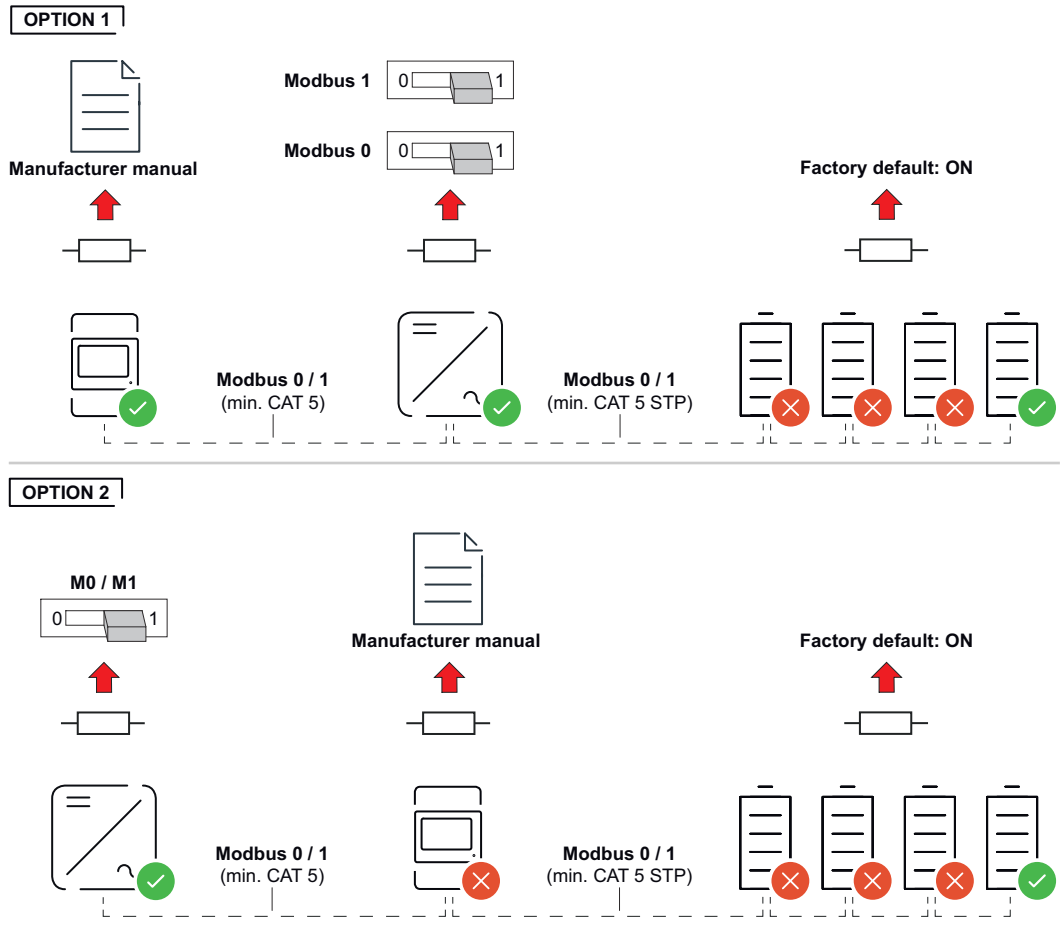


Slide the right-hand cover on the Reserva Pro BMS upwards and lift it off.

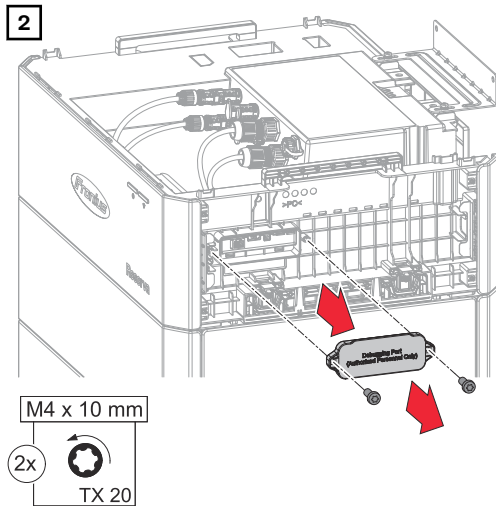

Loosen the 2 screws of the connection area cover with a screwdriver (TX20). Remove the connection area cover from the device.

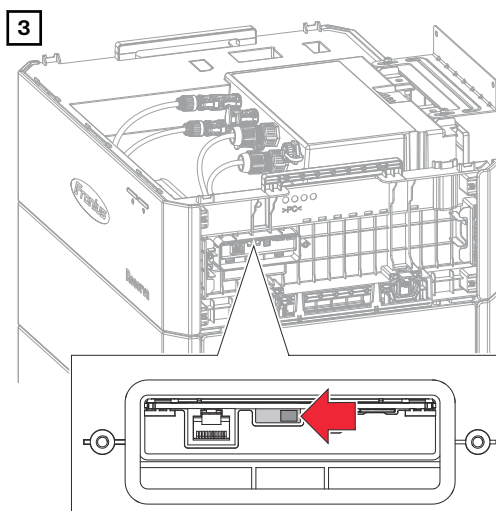


Set the "Terminal Resistor Switch" to the "OFF" position.

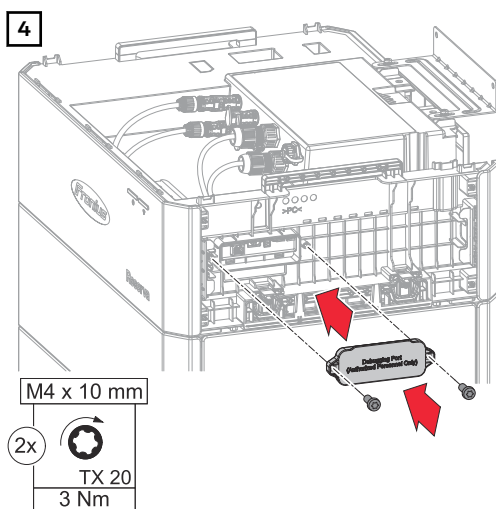

Place the cover on the connection area. Tighten the 2 screws with a screwdriver (TX20) and a torque of 3 Nm.

5

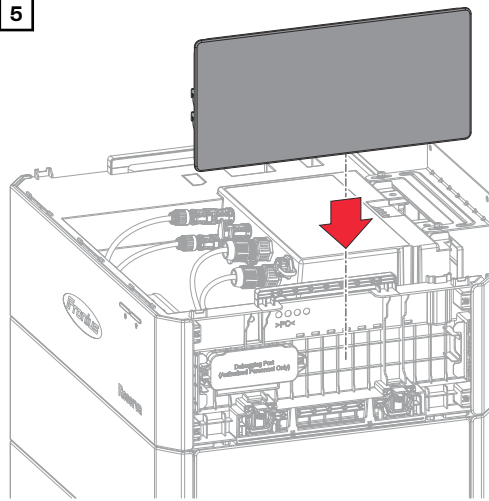

Push in the right-hand cover from above until the covers click into place.

Final tasks

Selecting the mounting material

Use appropriate mounting materials depending on the surface and pay attention to the recommendation for the screw dimensions for the L-shaped mounting bracket. A technical specialist is responsible for selecting appropriate mounting material.

Fitting the mounting bracket




CAUTION!

Danger of battery systems toppling over if not installed correctly.

This can result in injuries and damage to property.


- Secure the battery system against toppling over using the mounting bracket supplied.

1

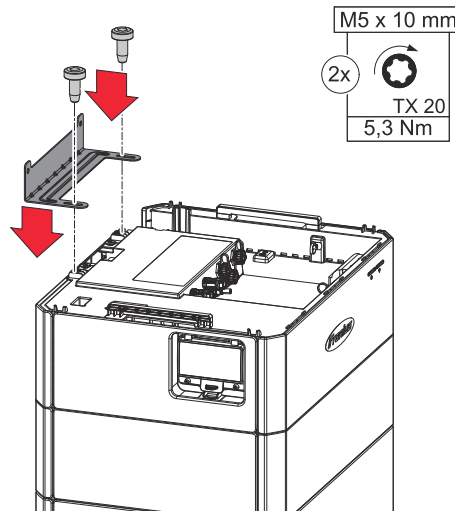


Fasten the mounting bracket to the BMS using the M5x10 TX20 screws supplied and a torque of 5.3 Nm.

2

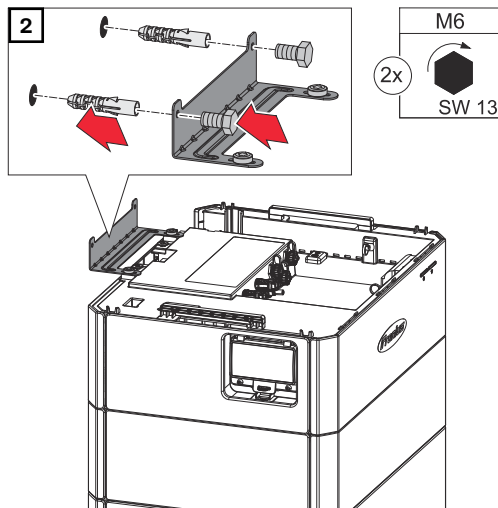


Attach the mounting bracket to the wall using suitable mounting material (see chapter [Selecting the mounting material](#) on page 53).

Securing the cables in the connection area

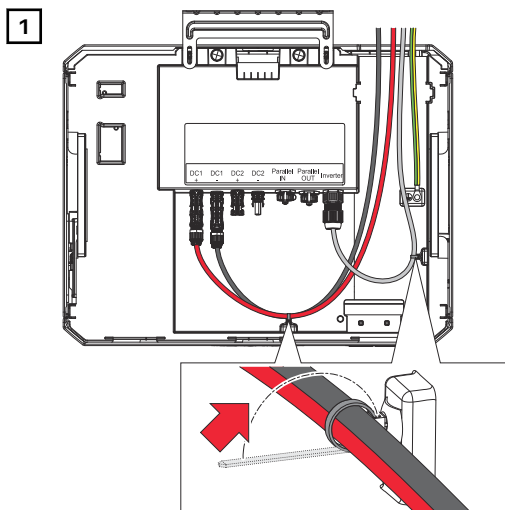

Lay the cables in the cable duct integrated in the connection area and secure them with the integrated cable ties.

Fitting the cover to the Reserva Pro BMS

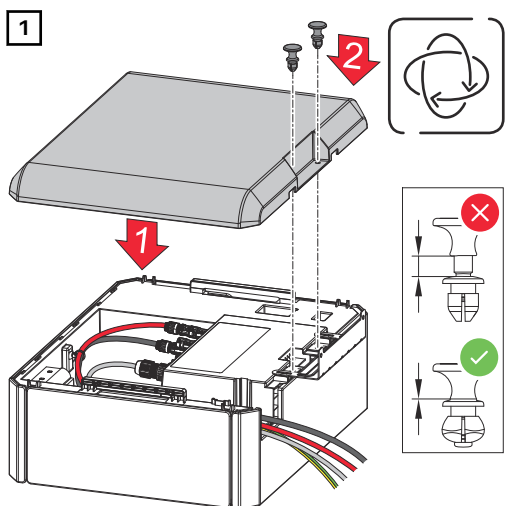

Place the (top) cover on the Reserva Pro BMS and secure it with the fastening clips supplied.

Replacing/adding the Reserva Pro module to the battery system

Safety



WARNING!

Danger due to soiled battery connections.
This can result in severe personal injury and damage to property.

- ▶ Protect the battery connections from dirt.
- ▶ Check the battery connections for soiling.
- ▶ Always use personal protective equipment (insulated gloves, safety goggles, protective clothing) when cleaning soiled battery connections and remove soiling with a lint-free cloth without the use of cleaning agents.



CAUTION!

Danger due to improper battery transportation or installation.
This can result in injuries.

- ▶ Use the integrated carrying handles for lifting the battery and setting it down.
- ▶ When lowering the battery, make sure that limbs do not come between the battery and the fixtures.
- ▶ Wear personal protective equipment.

Requirements for expanding the battery system

- Observe the following points when expanding the battery system in order to be able to use its full capacity:
- The State of Charge (SoC) must be 15% (enable **service mode**, see chapter [Setting the State of Charge \(SoC\) with Service Mode](#) on page 55).
 - Carry out the expansion within the first 2 years of starting for the first time.

NOTE!

Restriction applies to expansion of the battery system after 2 years.
Expansion of the battery system is possible after 2 years, but with the restriction that the added battery module is operated with the lowest State of Health (SoH) in the battery system.

Example of expansion outside the manufacturer's recommended period	
SoH of new Reserva Pro module	100%
SoH of installed Reserva Pro modules	96%
SoH of entire battery system	96%

Setting the State of Charge (SoC) with Service Mode

- ☐ To activate **Service Mode**, a connection to the user interface of the inverter is required, see chapter [Commissioning with the app](#) on page 69 or [Commissioning with the browser](#) on page 69.
- 1

Open the user interface of the inverter.



- 2 Log in to the login section with user **Customer** or **Technician** and the relevant password.
 - 3 Open the **Energy Management > Battery Management > Service Mode** menu area.
 - 4 Activate **Service Mode**.
 - 5 Click the **Save** button to save the settings.
- ✓ The service mode is activated and the battery is charged/discharged to 15% SoC.

Switching off the power to the photovoltaic system and battery

IMPORTANT! Allow the capacitors of the inverter to discharge.

1

Turn off the automatic circuit breaker. Set the switch position of the inverter's DC disconnect to "Off".



AC OFF




DC OFF


IMPORTANT! Before starting work on the battery, all LEDs on the LED status indicator must be unlit.

2


Set the switch position of the battery's DC disconnect to "Off".

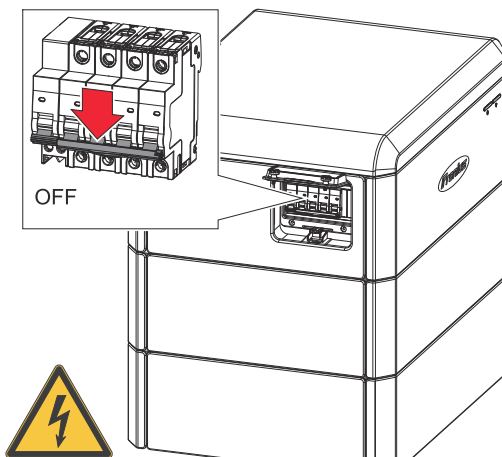

Removing the covers on the battery

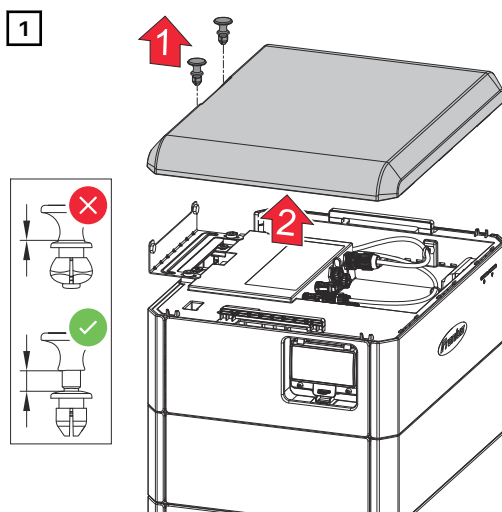


Remove the fastening clips from the top cover and lift off the cover.

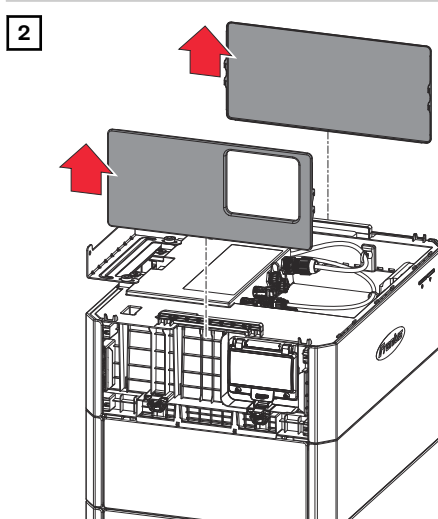


Slide the left and right-hand covers on the Reserva Pro BMS upwards and lift them off.

Disconnecting and removing the Reserva Pro BMS

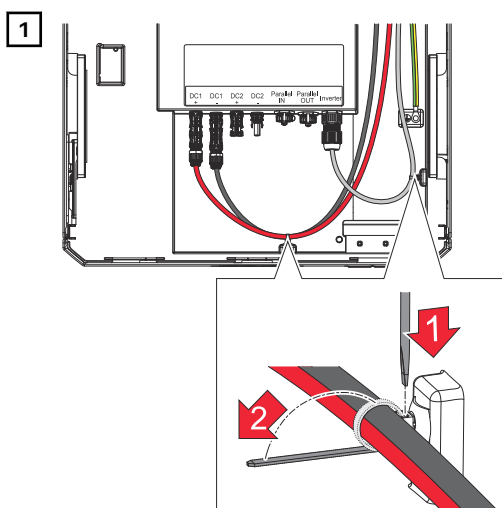


Detach the cables from the fastening clips.

2

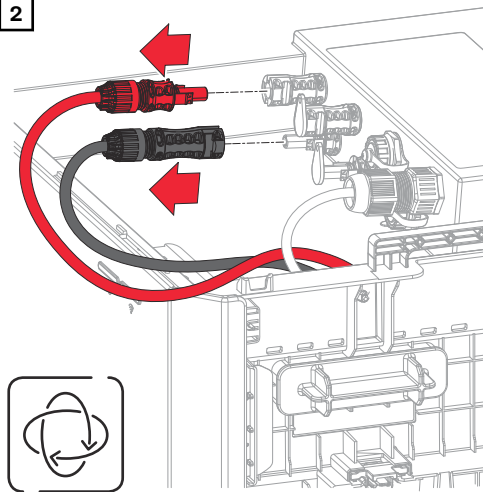

Release the MC4 plugs (+/-) using a suitable tool.


3

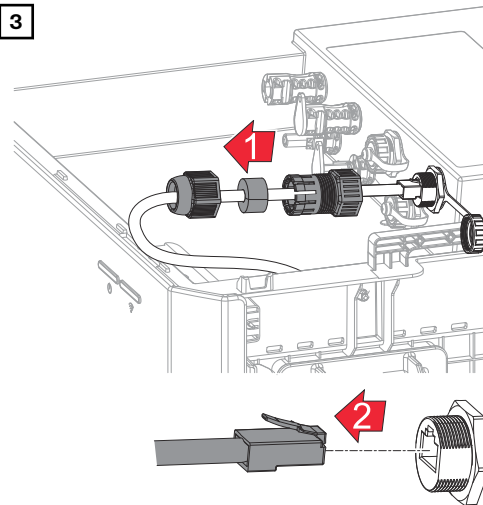


Unscrew the cable gland of the "IN-VERTER" data cable. Press the latch on the RJ45 plug and unplug the plug.

For batteries in parallel operation, also disconnect the "Parallel IN" and "Parallel OUT" data cables.


4

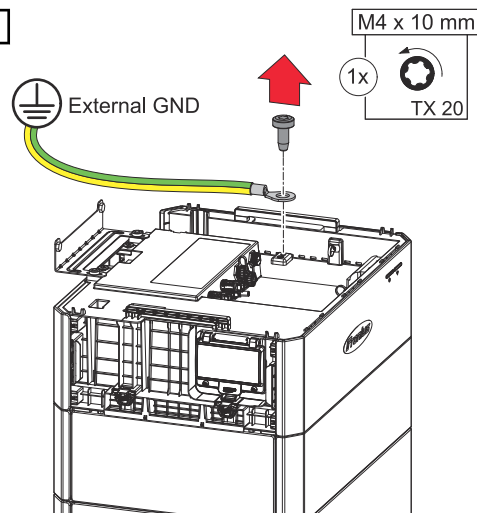


Using a screwdriver (TX20), loosen the ground conductor (PE).

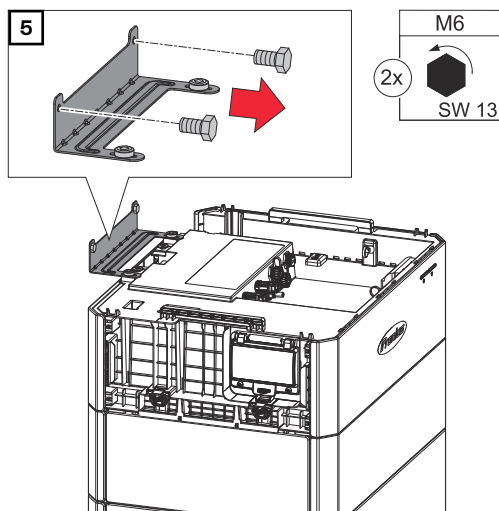

Release the L-shaped mounting bracket.

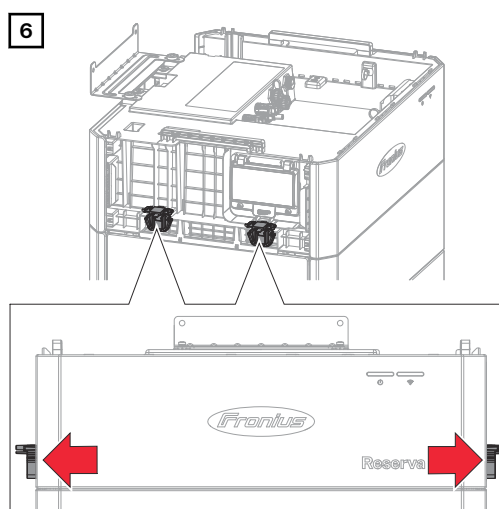


Pull out the 4 latches as far as they will go.

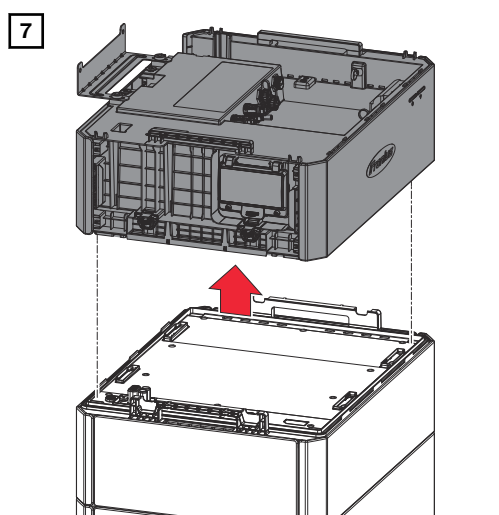


Lift the Reserva Pro BMS in parallel from the last Reserva Pro module.

Installing a new Reserva Pro module

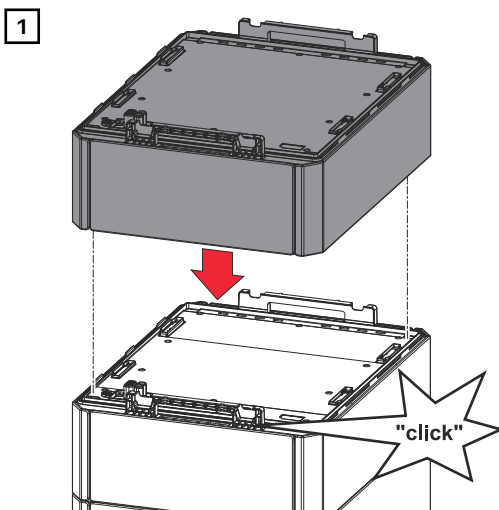


Arrange the new Reserva Pro module in parallel and press into place until the Reserva Pro module engages on both sides with an audible click.

Fitting the Reserva Pro BMS

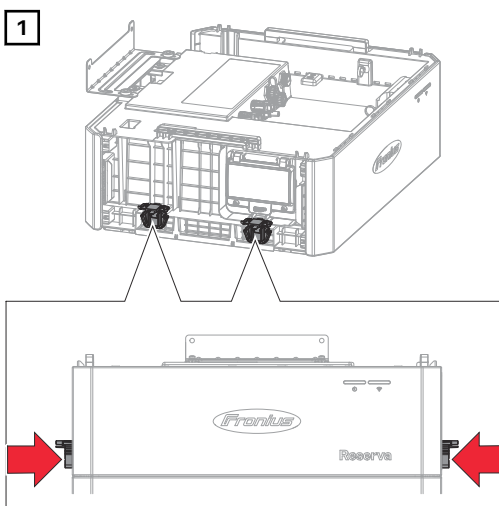


Press the 4 latches into their original position.

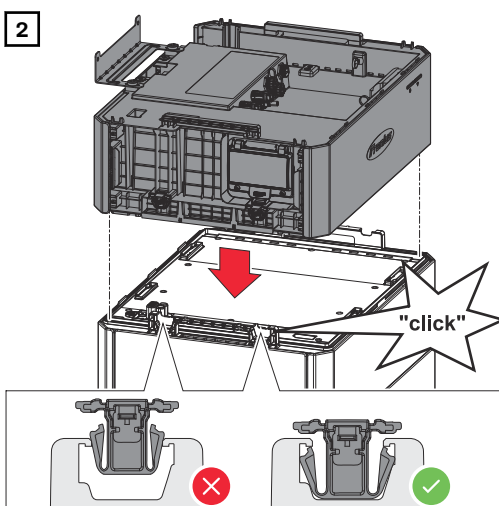


Arrange the Reserva Pro BMS in parallel on the last Reserva Pro module and press into place until the BMS engages on both sides with an audible click.

Fitting the side covers on the battery

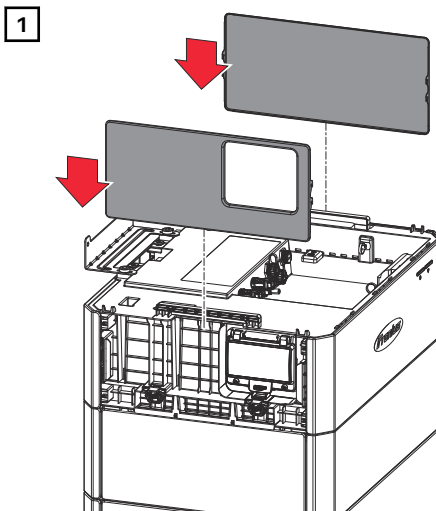

Push in the side covers from above until the covers click into place.


Connecting the Reserva Pro BMS

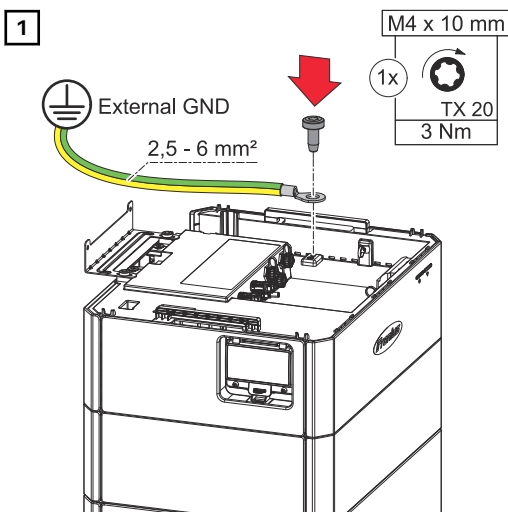


Fasten the ground conductor (PE) to the ground conductor connection using the M4x10 TX20 screw supplied and a torque of 3 Nm.


IMPORTANT!

Full selectivity of the overcurrent protection devices is only guaranteed if they are installed correctly.

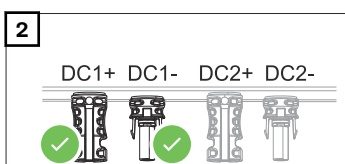


Push the MC4 plugs (+/-) into the DC1+/DC1- slots until they click into place.

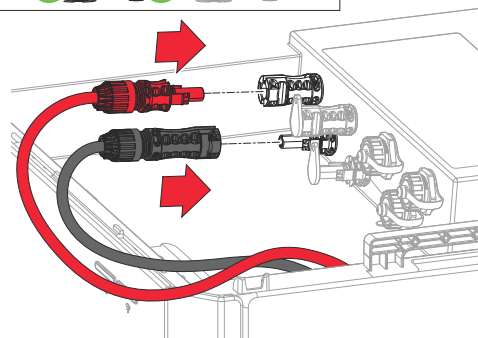

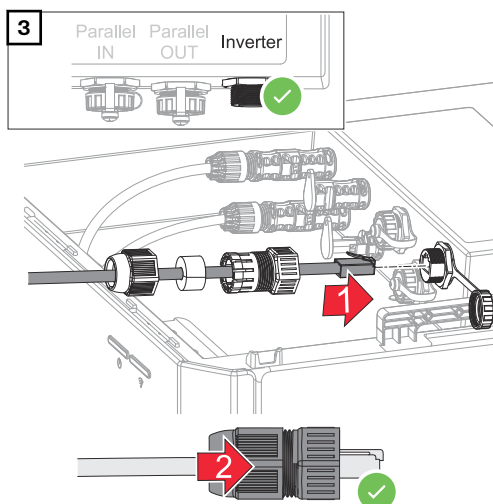

Connect the data cable to the "Inverter" data communication connection with an audible click. Fasten the union nut to the cable gland.

Securing the cables in the connection area

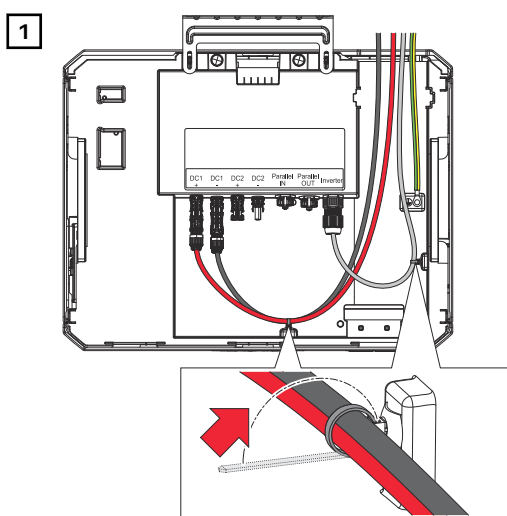

Lay the cables in the cable duct integrated in the connection area and secure them with the integrated cable ties.

Fitting the mounting bracket




CAUTION!


Danger of battery systems toppling over if not installed correctly.

This can result in injuries and damage to property.

- Secure the battery system against toppling over using the mounting bracket supplied.

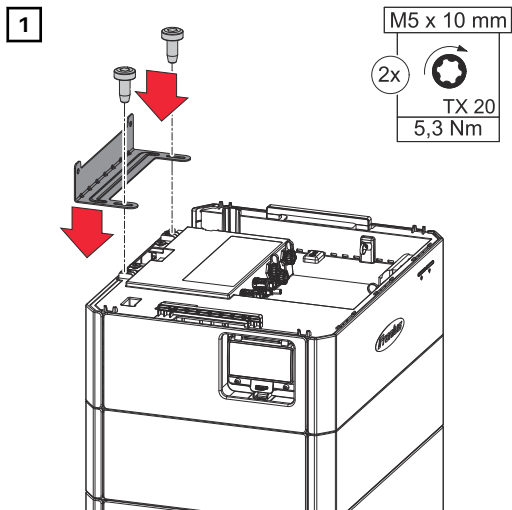


Fasten the mounting bracket to the BMS using the M5x10 TX20 screws supplied and a torque of 5.3 Nm.

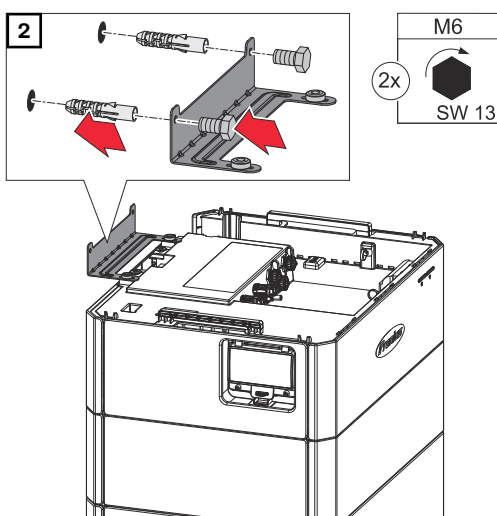

Attach the mounting bracket to the wall using suitable mounting material (see chapter [Selecting the mounting material](#) on page 53).

Fitting the cover to the Reserva Pro BMS

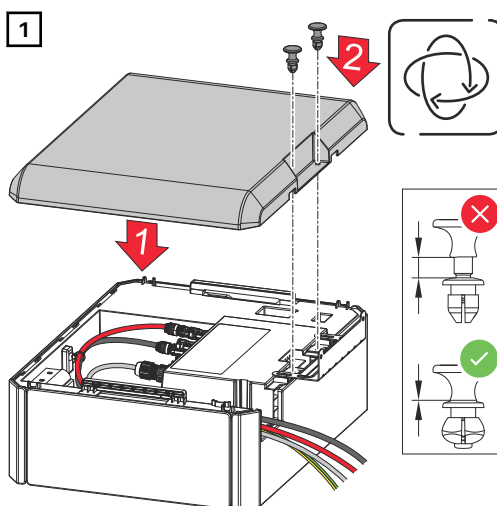


Place the (top) cover on the Reserva Pro BMS and secure it with the fastening clips supplied.

Commissioning

Switching on the photovoltaic system


Switching on the photovoltaic system

1

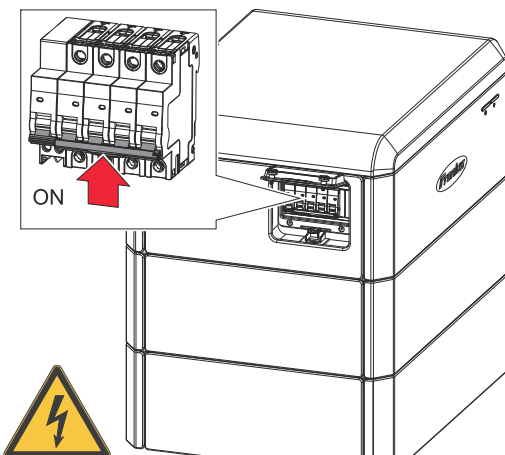


Set the switch position of the battery's DC disconnect to "On".

2

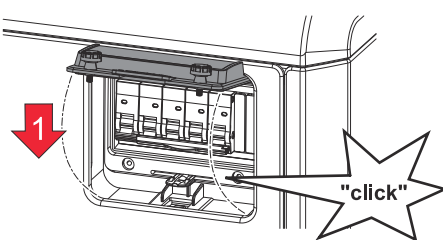

Close the cover on the DC disconnect with an audible click and secure it with the screws to prevent unauthorized opening.

3

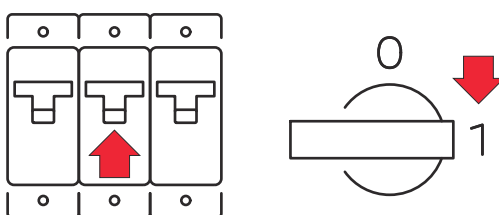

Turn on the automatic circuit breaker. Set the switch position of the inverter's DC disconnect to "On".

AC ON



DC ON

Manual system start

Requirements

There is no energy available from the PV modules or from the public grid. If backup power operation or battery operation are not possible (e.g., deep discharge protection of the battery), the inverter and battery switch off.

Notification of system shutdown


Status codes about the inactive state of the battery are displayed on the user interface of the inverter. A notification via e-mail can be activated in Fronius Solar.web.

Manual battery start (dark start) after a system shutdown


As soon as energy is available again, the inverter and the battery will start operation automatically. If the battery has switched off to protect against deep discharge for example, the battery must be started manually (dark start), see chapter [Switching on the photovoltaic system](#) on page 67.

Starting backup power mode after a system shutdown

The inverter requires a supply of energy from the battery to start backup power mode. This is established manually on the battery as described below.

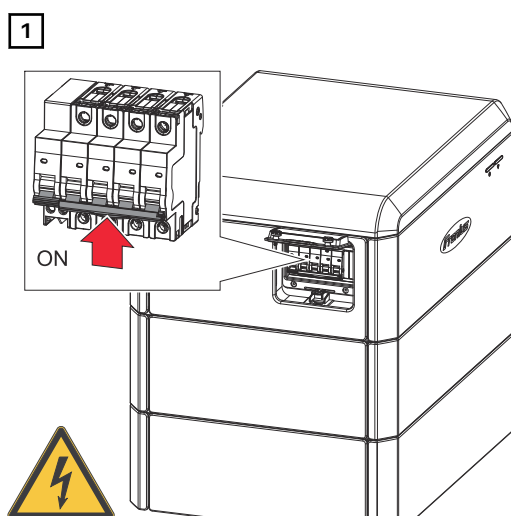

Set the switch position of the battery's DC disconnect to "On".

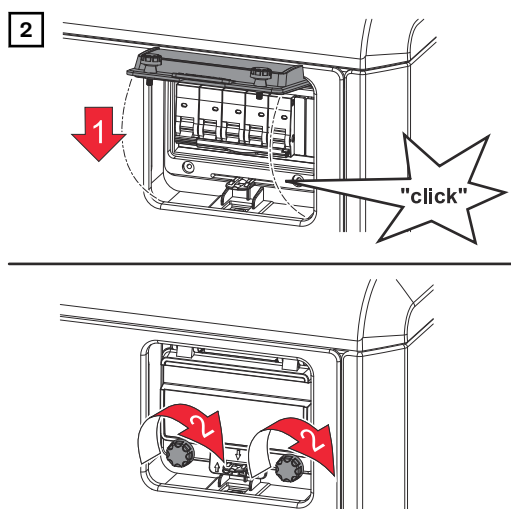

Close the cover on the DC disconnect or with an audible click and secure it with the screws to prevent unauthorized opening.

Settings – User interface of the inverter


General

IMPORTANT! Settings in the **Device Configuration** menu item may only be entered by staff trained to do so!

To access the **Device Configuration** menu item, you must log in with user “Technician” and the technician password.

Commissioning with the app

The Fronius Solar.start app is required for commissioning. Depending on the mobile device used to perform the installation, the app is available on the relevant platform.

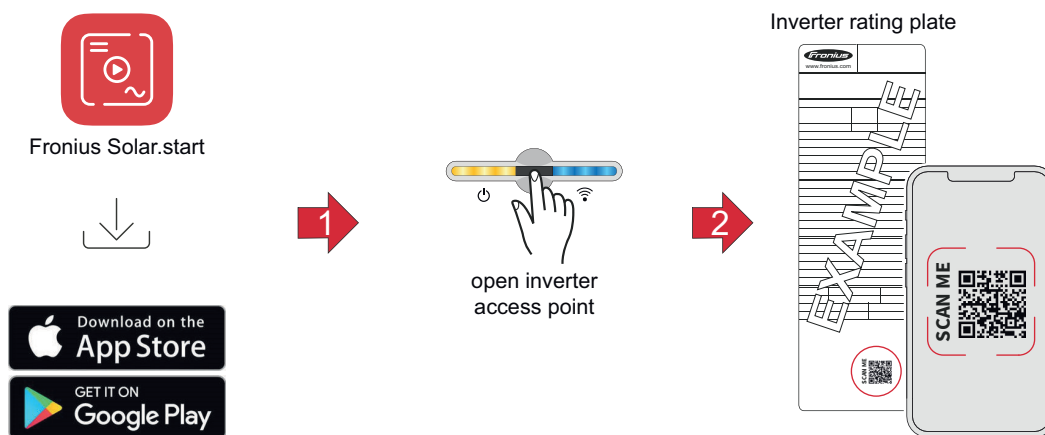


- 1 Download and install the Fronius Solar.start app.
- 2 Open the access point on the inverter by touching the sensor .
✓ *Communication LED flashes blue.*
- 3 Open the Fronius Solar.start app and scan the QR code on the rating plate of the inverter using a smartphone or tablet to connect to the inverter.
- 4 Add the battery as in chapter [Adding a battery in the user interface of the inverter](#) on page 70.

The network wizard and product setup can be performed independently. A network connection is required for the Fronius Solar.web installation wizard.

Commissioning with the browser

WiFi:

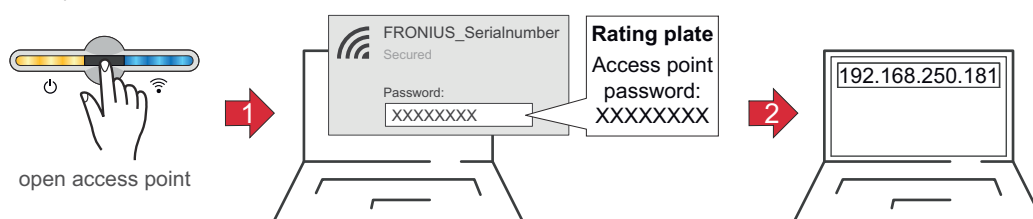


- 1 Open the access point on the inverter by touching the sensor .
✓ *Communications LED flashes blue.*
- 2 Establish the connection to the inverter in the network settings (the inverter is displayed with the name “FRONIUS_” and the serial number of the device).

- 3 Enter the password from the inverter's rating plate and confirm.
IMPORTANT!
To enter the password in Windows 10, first select the **Connect using a security key instead** link to be able to establish the connection with the password.
- 4 Enter the IP address 192.168.250.181 in the address bar of the browser and confirm to connect to the inverter.
- 5 Add the battery as in chapter [Adding a battery in the user interface of the inverter](#) on page 70.

The network wizard and product setup can be performed independently. A network connection is required for the Fronius Solar.web installation wizard.

Ethernet:

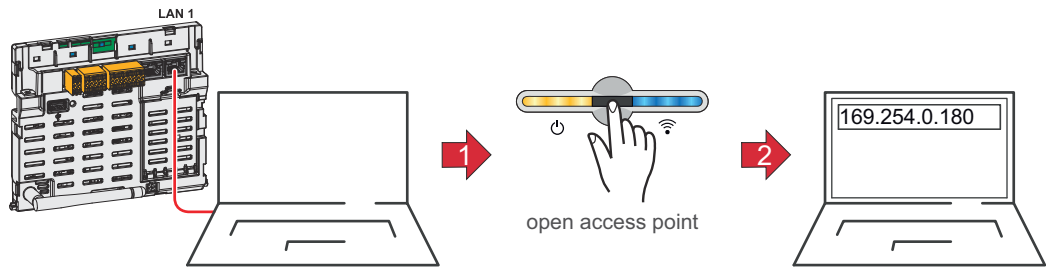

- 1 Establish a connection to the inverter (LAN1) using a network cable (min. CAT5 STP).
- 2 Open the access point on the inverter by touching the sensor .
✓ *Communications LED flashes blue.*
- 3 Enter the IP address 169.254.0.180 in the address bar of the browser and confirm to connect to the inverter.
- 4 Add the battery as in chapter [Adding a battery in the user interface of the inverter](#) on page 70.

The network wizard and product setup can be performed independently. A network connection is required for the Fronius Solar.web installation wizard.

Adding a battery in the user interface of the inverter

- 1 Open the user interface of the inverter.
 - 2 In the **Login** menu area or in the **User > User Login** menu area, log in with username and password.
 - 3 Go to the **Device Configuration > Components** menu area.
 - 4 Click on the **Add components+** button.
 - 5 Select the **Fronius battery** battery in the **Type** drop-down list.
 - 6 Click on the **Add** button.
 - 7 Click the **Save** button to save the settings.
- ✓ *The battery has been added to the PV system.*

Firmware update

Obsolete firmware/software versions may lead to incompatibilities between the inverter and the battery. In this case, the following steps are to be performed:

- 1 Open the user interface of the inverter.
- 2 Log in with user name and password in the **Log in** menu field or in the **User > User login** menu field.

- 3** Call up the **System > Update** menu field.
 - 4** Drag the firmware file into the **drop file here** field, or select via **Select file**.
- ✓ *The update is carried out.*


All available updates are provided on the product page and in the "Fronius Download Search" area at www.fronius.com.

Switching the battery off and on

Switching off the battery

IMPORTANT! Before starting work on the battery, all LEDs on the LED status indicator must be unlit.


1

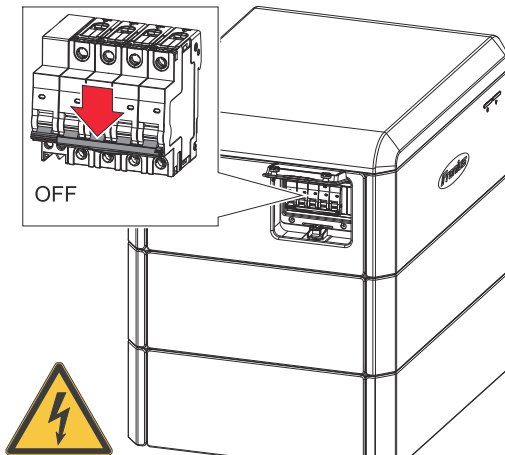

Set the switch position of the battery's DC disconnect to "Off".


Switching on the battery

1

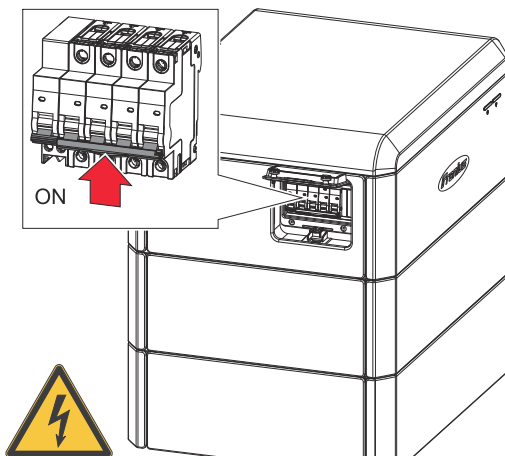

Set the switch position of the battery's DC disconnect to "On".

2

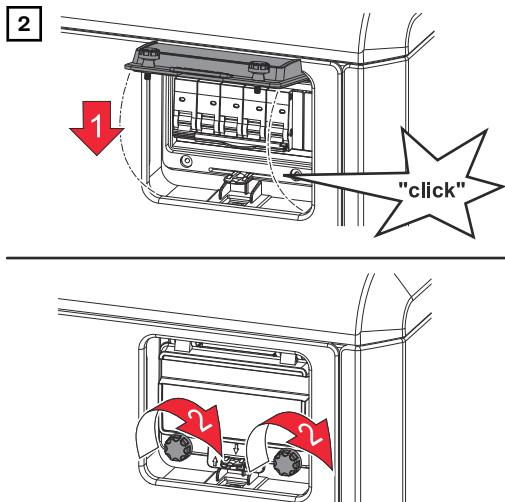

Close the cover on the DC disconnect or with an audible click and secure it with the screws to prevent unauthorized opening.

Appendix

Service, maintenance and disposal

Cleaning

Wipe the device, if necessary, with a damp cloth.
Do not use cleaning agents, scouring agents, solvents, or similar products to clean the device.

Maintenance

The device is maintenance-free. Service work may only be carried out by qualified technical personnel.

Forced re-charging

Forced re-charging to protect against deep discharge takes place automatically using solar energy or energy from the grid if the battery's state of charge (SoC) falls below the minimum level and the requirements are met.

NOTE!

Danger of deep discharge of battery modules.

This can result in irreparable damage to the battery modules.

- ▶ If the battery falls below the minimum state of charge (SoC), it must be re-charged within 7 days to protect against deep discharge.

Requirements for forced re-charging of the battery system

- Set the switch position of the battery's DC disconnect to "On".
- Grid-connected operation of the inverter.

Start forced re-charging if the battery has switched off automatically to protect against deep discharge, see chapter [Switching on the photovoltaic system](#) on page 67.

Disposal

In accordance with the EU Directive and national law, the following products must be disposed of separately and recycled:

- Waste electrical and electronic equipment
- Used batteries (portable batteries, industrial batteries)

Used equipment and batteries must be returned to the distributor or an authorized local collection system. Do not dispose of batteries with domestic waste. Protect batteries from high temperatures, direct sunlight, moisture and corrosive environments.

Arrange for the safe collection and proper disposal of damaged, leaking or used batteries by a battery recycling company or the Fronius Service Partner.

In addition, it should be noted that batteries contain substances that, if disposed of improperly, can have a significant negative impact on the environment as well as on human health and the safety of persons, in particular due to the leakage of hazardous substances such as heavy metals or electrolytes, which can contaminate soil, water and air.

This ensures environmental protection and the sustainable use of natural resources.

Packaging materials

- Collect separately
- Observe local regulations
- Compress the cardboard box to reduce volume

Warranty provisions

Warranty

Detailed warranty conditions specific to your country can be found at <https://www.fronius.com/en/download-center?searchword=Warranty+conditions>.

If there is a warranty for the relevant product, register the product at <https://warranty.fronius.com/> and activate or extend the warranty.

Technical data

Fronius Reserva Pro 12.0

General data	
Usable capacity ¹⁾	56.6 Ah
Max. charging current	
-20 °C to -10 °C	2.6 A
-10 °C to 5 °C	13.4 A
5 °C to 10 °C	20.2 A
10 °C to 15 °C	33.7 A
15 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A
Max. discharge current (A)	
-20 °C to -10 °C	6.7 A
-10 °C to 0 °C	13.4 A
0 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A
Permitted ambient temperature	-20 °C to 50 °C
Optimum operating temperature	15 °C to 30 °C
Permissible humidity	5% to 95%
Cooling	Convection cooling
Altitude	≤ 2000 m
Reserva Pro module discharge rate (25 °C)	≤ 1% / month
Number of battery modules	3
Max. battery systems in parallel operation	4
Data communication between inverter and battery	RS485
Certifications	IEC 62619:2022 CE VDE-AR-E 2510-50:2017-05 EN 62477-1:2012+A11+A1+A12 IEC 62040-1:2017+A1+A2
EMC standards	EN IEC 61000-6-2:2019 EN IEC 61000-6-3:2021
UN transport test standard	UN 38.3
Certifications for environmental protection	RoHS REACH
Protection class (when installed)	IP65
Corrosivity category	C3
Protective class	2
Overvoltage category	2
Pollution degree	2

General data	
Dimensions incl. covers ²⁾ H × W × D	775 × 579 × 449 mm
Weight	126 kg
Battery code	IFpP17/102/354/[(22S)3S]E/-20+50/95

Electrical data	
Number of modules	3
Nominal energy	12 kWh
Usable energy	11.9 kWh
Rated voltage	212.5 V
Operating AC voltage range	165 - 240 V
Charging/discharging capacity	11.8 kW
Expected short circuit current	1.89 kA

Fronius Reserva Pro 16.0

General data	
Usable capacity ¹⁾	56.6 Ah
Max. charging current	
-20 °C to -10 °C	2.6 A
-10 °C to 5 °C	13.4 A
5 °C to 10 °C	20.2 A
10 °C to 15 °C	33.7 A
15 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A
Max. discharge current (A)	
-20 °C to -10 °C	6.7 A
-10 °C to 0 °C	13.4 A
0 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A
Permitted ambient temperature	-20 °C to 50 °C
Optimum operating temperature	15 °C to 30 °C
Permissible humidity	5% to 95%
Cooling	Convection cooling
Altitude	≤ 2000 m
Reserva Pro module discharge rate (25 °C)	≤ 1% / month
Number of battery modules	4
Max. battery systems in parallel operation	4
Data communication between inverter and battery	RS485

General data	
Certifications	IEC 62619:2022 CE VDE-AR-E 2510-50:2017-05 EN 62477-1:2012+A11+A1+A12 IEC 62040-1:2017+A1+A2
EMC standards	EN IEC 61000-6-2:2019 EN IEC 61000-6-3:2021
UN transport test standard	UN 38.3
Certifications for environmental protection	RoHS REACH
Protection class (when installed)	IP65
Corrosivity category	C3
Protective class	2
Overvoltage category	2
Pollution degree	2
Dimensions incl. covers ²⁾ H × W × D	935 × 579 × 449 mm
Weight	162 kg
Battery code	IFpP17/102/354/[(22S)4S]E/-20+50/95

Electrical data	
Number of modules	4
Nominal energy	16 kWh
Usable energy	15.9 kWh
Rated voltage	283.3 V
Operating AC voltage range	220 - 321 V
Charging/discharging capacity	15.8 kW
Expected short circuit current	1.99 kA

Fronius Reserva Pro 20.0

General data	
Usable capacity ¹⁾	56.6 Ah
Max. charging current	
-20 °C to -10 °C	2.6 A
-10 °C to 5 °C	13.4 A
5 °C to 10 °C	20.2 A
10 °C to 15 °C	33.7 A
15 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A

General data	
Max. discharge current (A)	
-20 °C to -10 °C	6.7 A
-10 °C to 0 °C	13.4 A
0 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A
Permitted ambient temperature	-20 °C to 50 °C
Optimum operating temperature	15 °C to 30 °C
Permissible humidity	5% to 95%
Cooling	Convection cooling
Altitude	≤ 2000 m
Reserva Pro module discharge rate (25 °C)	≤ 1% / month
Number of battery modules	5
Max. battery systems in parallel operation	4
Data communication between inverter and battery	RS485
Certifications	IEC 62619:2022 CE VDE-AR-E 2510-50:2017-05 EN 62477-1:2012+A11+A1+A12 IEC 62040-1:2017+A1+A2
EMC standards	EN IEC 61000-6-2:2019 EN IEC 61000-6-3:2021
UN transport test standard	UN 38.3
Certifications for environmental protection	RoHS REACH
Protection class (when installed)	IP65
Corrosivity category	C3
Protective class	2
Overvoltage category	2
Pollution degree	2
Dimensions incl. covers ²⁾ H × W × D	1095 × 579 × 449 mm
Weight	198 kg
Battery code	IFpP17/102/354/[(22S)5S]E/-20+50/95

Electrical data	
Number of modules	5
Nominal energy	20 kWh
Usable energy	19.9 kWh
Rated voltage	354.2 V
Operating AC voltage range	275 - 401 V

Electrical data	
Charging/discharging capacity	19.7 kW
Expected short circuit current	2.08 kA

Fronius Reserva Pro 24.0

General data	
Usable capacity ¹⁾	56.6 Ah
Max. charging current	
-20 °C to -10 °C	2.6 A
-10 °C to 5 °C	13.4 A
5 °C to 10 °C	20.2 A
10 °C to 15 °C	33.7 A
15 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A
Max. discharge current (A)	
-20 °C to -10 °C	6.7 A
-10 °C to 0 °C	13.4 A
0 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A
Permitted ambient temperature	-20 °C to 50 °C
Optimum operating temperature	15 °C to 30 °C
Permissible humidity	5% to 95%
Cooling	Convection cooling
Altitude	≤ 2000 m
Reserva Pro module discharge rate (25 °C)	≤ 1% / month
Number of battery modules	6
Max. battery systems in parallel operation	4
Data communication between inverter and battery	RS485
Certifications	IEC 62619:2022 CE VDE-AR-E 2510-50:2017-05 EN 62477-1:2012+A11+A1+A12 IEC 62040-1:2017+A1+A2
EMC standards	EN IEC 61000-6-2:2019 EN IEC 61000-6-3:2021
UN transport test standard	UN 38.3
Certifications for environmental protection	RoHS REACH
Protection class (when installed)	IP65
Corrosivity category	C3
Protective class	2

General data	
Overvoltage category	2
Pollution degree	2
Dimensions incl. covers ²⁾ H × W × D	1255 × 579 × 449 mm
Weight	234 kg
Battery code	IFpP17/102/354/[(22S)6S]E/-20+50/95

Electrical data	
Number of modules	6
Nominal energy	24 kWh
Usable energy	23.9 kWh
Rated voltage	425 V
Operating AC voltage range	330 - 481 V
Charging/discharging capacity	23.7 kW
Expected short circuit current	2.18 kA

Fronius Reserva Pro 28.0

General data	
Usable capacity ¹⁾	56.6 Ah
Max. charging current	
-20 °C to -10 °C	2.6 A
-10 °C to 5 °C	13.4 A
5 °C to 10 °C	20.2 A
10 °C to 15 °C	33.7 A
15 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A
Max. discharge current (A)	
-20 °C to -10 °C	6.7 A
-10 °C to 0 °C	13.4 A
0 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A
Permitted ambient temperature	-20 °C to 50 °C
Optimum operating temperature	15 °C to 30 °C
Permissible humidity	5% to 95%
Cooling	Convection cooling
Altitude	≤ 2000 m
Reserva Pro module discharge rate (25 °C)	≤ 1% / month
Number of battery modules	7
Max. battery systems in parallel operation	4

General data	
Data communication between inverter and battery	RS485
Certifications	IEC 62619:2022 CE VDE-AR-E 2510-50:2017-05 EN 62477-1:2012+A11+A1+A12 IEC 62040-1:2017+A1+A2
EMC standards	EN IEC 61000-6-2:2019 EN IEC 61000-6-3:2021
UN transport test standard	UN 38.3
Certifications for environmental protection	RoHS REACH
Protection class (when installed)	IP65
Corrosivity category	C3
Protective class	2
Overvoltage category	2
Pollution degree	2
Dimensions incl. covers ²⁾ H × W × D	1415 × 579 × 449 mm
Weight	270 kg
Battery code	IFpP17/102/354/[(22S)7S]E/-20+50/95

Electrical data	
Number of modules	7
Nominal energy	28 kWh
Usable energy	27.9 kWh
Rated voltage	495.8 V
Operating AC voltage range	385 - 562 V
Charging/discharging capacity	27.6 kW
Expected short circuit current	2.27 kA

Fronius Reserva Pro 32.0

General data	
Usable capacity ¹⁾	56.6 Ah
Max. charging current	
-20 °C to -10 °C	2.6 A
-10 °C to 5 °C	13.4 A
5 °C to 10 °C	20.2 A
10 °C to 15 °C	33.7 A
15 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A

General data	
Max. discharge current (A)	
-20 °C to -10 °C	6.7 A
-10 °C to 0 °C	13.4 A
0 °C to 48 °C	50 A
48 °C to 50 °C	2.6 A
Permitted ambient temperature	-20 °C to 50 °C
Optimum operating temperature	15 °C to 30 °C
Permissible humidity	5% to 95%
Cooling	Convection cooling
Altitude	≤ 2000 m
Reserva Pro module discharge rate (25 °C)	≤ 1% / month
Number of battery modules	8
Max. battery systems in parallel operation	4
Data communication between inverter and battery	RS485
Certifications	IEC 62619:2022 CE VDE-AR-E 2510-50:2017-05 EN 62477-1:2012+A11+A1+A12 IEC 62040-1:2017+A1+A2
EMC standards	EN IEC 61000-6-2:2019 EN IEC 61000-6-3:2021
UN transport test standard	UN 38.3
Certifications for environmental protection	RoHS REACH
Protection class (when installed)	IP65
Corrosivity category	C3
Protective class	2
Overvoltage category	2
Pollution degree	2
Dimensions incl. covers ²⁾ H × W × D	1575 × 579 × 449 mm
Weight	306 kg
Battery code	IFpP17/102/354/[(22S)8S]E/-20+50/95

Electrical data	
Number of modules	8
Nominal energy	32 kWh
Usable energy	31.9 kWh
Rated voltage	566.7 V
Operating AC voltage range	440 - 642 V





Electrical data	
Charging/discharging capacity	31.6 kW
Expected short circuit current	2.37 kA

Explanation of footnotes

- 1) 99.5% depth of discharge (DoD), 0.25 C charge and discharge rate at 25 °C.
- 2) The protrusion of the adjustable feet and mounting bracket was not taken into account in the dimensions.

Dimensions

Fronius Reserva Pro

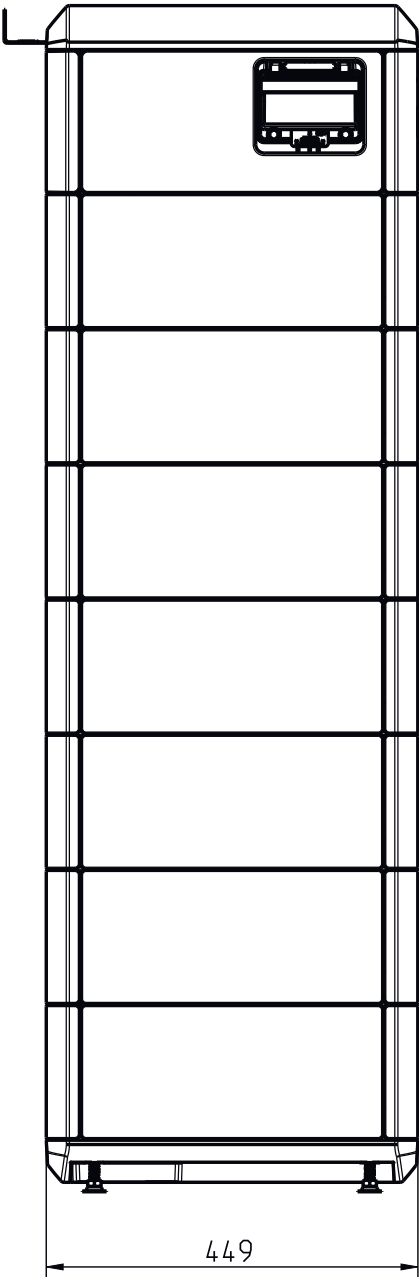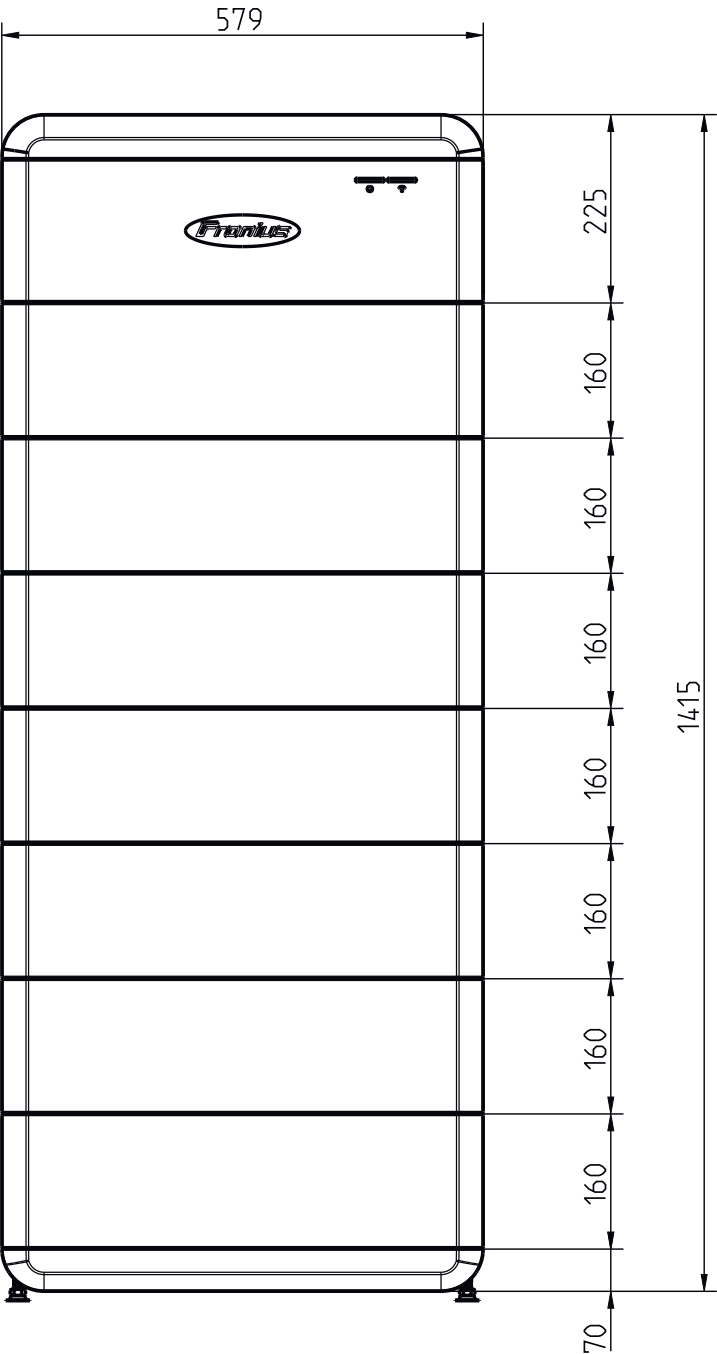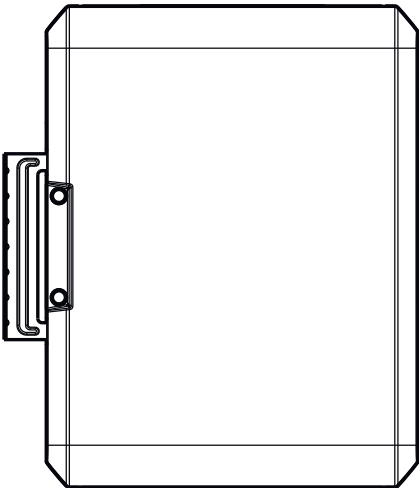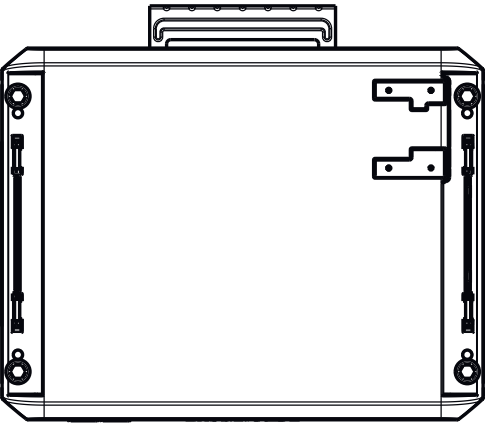



fronius.com/en/solar-energy/installers-partners/products-solutions/monitoring-digital-tools

MONITORING &
DIGITAL TOOLS

Fronius International GmbH

Froniusstraße 1
4643 Pettenbach
Austria
contact@fronius.com
www.fronius.com

At www.fronius.com/contact you will find the contact details of all Fronius subsidiaries and Sales & Service Partners.